

Bonriki Inundation Vulnerability Assessment

Economic analysis of water management options for impacts from inundation and climate variability under current abstraction rates, Bonriki water reserve, South Tarawa, Kiribati

Anna Rios Wilks

©Copyright Secretariat of the Pacific Community (SPC) 2015

All rights for commercial / for profit reproduction or translation, in any form, reserved. SPC authorises the partial reproduction or translation of this material for scientific, educational or research purposes, provided that SPC and the source document are properly acknowledged. Permission to reproduce the document and/or translate in whole, in any form, whether for commercial / for profit or non-profit purposes, must be requested in writing. Original SPC artwork may not be altered or separately published without permission.

Original text: English

Secretariat of the Pacific Community Cataloguing-in-publication data

SPC Technical Report SPC00011

March 2015

SPC DISCLAIMER

While care has been taken in the collection, analysis, and compilation of the data, they are supplied on the condition that the Secretariat of Pacific Community shall not be liable for any loss or injury whatsoever arising from the use of the data.

Secretariat of the Pacific Community
Geoscience Division (GSD)
Private Mail Bag, GPO Suva, Fiji Islands
Telephone: (679) 338 1377
Fax: (679) 337 0040
Email: paulah@spc.int
www.spc.int
www.sopac.org

This report has been produced with the financial assistance from the Secretariat of the Pacific Community.

Table of Contents

Acknowledgements	iii
List of Abbreviations	iv
Executive Summary	v
Objective	v
Results	v
1. Introduction	1
1.1. Background	1
1.2. Purpose of this report	2
1.3. Scope of this report.....	3
2. Data and background information.....	8
2.1. Tarawa current water sources	8
2.2. Alternative water sources	9
2.3. The daily water production target	12
3. Methodology.....	14
3.1. Analysis methodology	14
3.2. Modelling scenarios	16
3.3. Finding the least costly source of supplementary water	16
3.4. Evaluating the significance of threats to the groundwater supply	19
3.5. Summary of analysis assumptions	19
4. Results.....	22
4.1. (A) General cost estimates (if rainwater or desalination was required to produce 1,700 kL every day, 100% of the time).....	22
4.2. (B) Least costly method of supplementation in illustrative scenarios	27
4.3. (C) Total costs in each scenario and comparison threats to Bonriki	29
4.4. Sensitivity analysis.....	31
5. Key findings and management implications	34
5.1. Key findings	34
5.2. Implications for future management	35
6. Enabling environment and future work required	37
6.1. Financing: Who pays?	37
6.2. Environmental assessments.....	37
6.3. Operating desalination plants	37
6.4. Distribution of water	38
6.5. Groundwater supply sustainability, protection and community ownership	39
6.6. Responsible water management	39
6.7. Incentivising small-scale rainwater harvesting and maintenance	40

6.8. Replicability	41
References	42
Annexes	45
Annex 1: Preliminary findings of the Bonriki Inundation Vulnerability Assessment groundwater models	45
Annex 2: Bonriki Inundation Vulnerability Assessment inundation modelling	45

List of Tables

Table 1: Percent of households using each water source.	8
Table 2: Previous desalination experience.	10
Table 3: Kiribati population in 2005 and 2010, and the forecasted population for 2015.	13
Table 4: Total basic water needs according to the Sphere standard.....	14
Table 5: Costs of water production options.	15
Table 6: Scenarios and groundwater impact.	17
Table 7: Summary of general analysis assumptions.	20
Table 8: Large-scale rainwater harvesting assumptions.....	21
Table 9: Desalination assumptions.	22
Table 10: General cost of production for large-scale rainwater harvesting (LSRH) and desalination, in Australian dollars.....	23
Table 11: Cost (in Australian dollars) of supplying water under different scenarios.....	28
Table 12: Scenario total cost comparisons.	29
Table 13: Comparison of main desalination cost estimates with those based on Metutera (2002).....	32
Table A2: Seawater inundation extents and impact on groundwater.....	45

List of Figures

Figure 1. Bonriki Water Reserve Location	2
Figure 2. Bonriki Inundation Vulnerability Assessment project components	3
Figure 3: Bonriki area.....	5
Figure 4: Computer generated image of Bonriki freshwater reserve.....	6
Figure 5: Expected water requirements under the scenarios (total volumes over 6,208 days modelled).....	18
Figure 6: Comparison of large-scale rainwater harvesting to desalination.	24
Figure 7: Comparing costs of large-scale rainwater harvesting and desalination supply (production and distribution costs) to cost of supply via household rainwater harvesting (AUD/kL, no discounting). LSRH = large-scale rainwater harvesting.....	26

Acknowledgements

The BIVA project is part of the Australian Government's Pacific-Australia Climate Change Science and Adaptation Planning Program (PACCSAP), within the International Climate Change Adaptation Initiative. The project was developed by the Secretariat of the Pacific Community's (SPC) Geoscience Division (GSD) in partnership with the Australian Government and the Government of Kiribati (GoK).

Key GoK stakeholders that contributed to the implementation of the project were:

- Ministry of Public Works and Utilities (MPWU), in particular the Water Engineering Unit with the MPWU
- The Public Utilities Board (PUB), in particular the Water and Sanitation Division and the Customer Relations Division within the PUB
- The Office of the President, in particular the Disaster Management Office
- The Ministry of Environment, Lands and Agricultural Development (MELAD) Lands Division
- The Ministry of Fisheries and Marine Resources Development (MFMRD) Minerals Division
- Members of the Kiribati National Expert Group on climate change and disaster risk management (KNEG)

The Bonriki Village community members also played a key role in the implementation of the project. Community members participated in the school water science and mapping program, assisted with construction of new piezometers and data collection for the groundwater component, and shared their knowledge and experiences with regards to historical inundation events and coastal processes.

Key technical advisors involved with implementation of the project included:

- Flinders University, Adelaide, Australia
- University of Western Australia, Perth, Australia
- The University of Auckland, Auckland, New Zealand
- United Nations Educational, Scientific and Cultural Organization, Institute for Water Education (UNESCO-IHE), Delft, the Netherlands
- Technical advisors Tony Falkland and Ian White

List of Abbreviations

BIVA	Bonriki Inundation Vulnerability Assessment
kL	kilolitre = 1,000 litres
LSRH	large-scale rainwater harvesting
PACCSAP	Pacific–Australia Climate Change Science and Adaptation Planning
PDaLo	Pacific Damage and Loss Information System
PUB	Public Utilities Board
SPC	Secretariat of the Pacific Community
TWMP	Tarawa Water Master Plan

Executive Summary

This analysis is produced as part of the Bonriki Inundation Vulnerability Assessment project, part of the Australian government's Pacific–Australia Climate Change Science and Adaptation Planning Program (PACCSAP), within the International Climate Change Adaptation Initiative. The Bonriki Inundation Vulnerability Assessment project aims to improve understanding of the vulnerability of the Bonriki freshwater reserve to coastal hazards and climate change and variability. Improving knowledge of risks to this freshwater resource will enable better adaptation planning by the Government of Kiribati. Seawater inundations of a certain magnitude are likely to impact the salinity of Bonriki's groundwater lenses (the main sources of government-provided water) and the consequent volume of potable water supplied to the population. In the case that these groundwater lenses become too saline, it would be necessary to use alternative water sources to produce supplementary freshwater for the inhabitants of South Tarawa.

Objective

This economic analysis provides an assessment of the costs and benefits of using either rainwater or reverse osmosis desalination to fully supplement the Bonriki groundwater so that a target daily water volume (1,700 kL/day) can consistently be produced by the Government Public Utilities Board (PUB) in the face of threats to the supply. The resulting least-cost option is then used in scenario analysis to estimate the cost of seawater inundation (and rainfall variability) to the PUB in terms of their effect on overall water production costs.

Results

Least-cost option to fully supplement government groundwater supply: Desalination

The two main options considered in this report as back-up water sources for Bonriki are large-scale rainwater harvesting (LSRH) and desalination, both of which are designed to be able to provide the target 1,700 kL per day if required. Cost estimates support previous studies such as the Tarawa Water Master Plan (White 2010a) in concluding that desalination is the more cost-efficient option for large-scale water production. The unit production cost (when using a zero discount rate) ranges between Australian dollar (AUD) 5.1 and 5.5/kL, depending on the time frame of the analysis, compared with the cost of LSRH, which ranges between AUD 9.4 and 21.6/kL. In the 10-year analysis, desalination unit costs are approximately only 25% of those of LSRH. When using higher discount rates, the present value of unit costs of both options decreases, but desalination remains cheaper than LSRH, regardless of the discount rate, large changes in fuel prices, increased costs from outsourcing parts of the desalination production and maintenance process to external contractors, and changes in the abstraction rates. Nevertheless, if future research finds that environmental impacts are significant, desalination may become a less cost-efficient option.

Groundwater remains the least costly source of water

Although desalinated water is less costly than LSRH, it is still more costly than groundwater supplied from Bonriki. The estimated cost of groundwater (White 2010a) is AUD 3.60/kL, whereas the

minimum expected cost for desalinated water is AUD 5.06/kL using a zero discount rate. In addition, desalination has far greater energy demands than groundwater abstraction and, given that energy is presently supplied via diesel combustion, desalination will produce more carbon emissions and increase Kiribati's trade balance deficit through higher diesel imports. Consequently, it is clear that groundwater is still Kiribati's least costly water source and that protecting groundwater reserves from human pressures such as encroachment (White 2010a) should be a key focus in the future.

Small-scale household rainwater harvesting as additional private water source

Although household rainwater harvesting cannot be relied on as a backup to groundwater and would be susceptible to extreme droughts, it is a relatively low-cost option for providing small volumes of extra water in order to reduce stress on the PUB system during normal weather conditions. As discussed in the results section, if the normal 50% loss through distribution is assumed (Fraser Thomas Partners 2012; White 2010a), then the total cost of providing water to households via desalination is higher than that of small-scale household rainwater harvesting. This supports a recommendation of incentivising household rainwater harvesting in order to produce additional water, independently of the government (PUB)-supplied system.

Natural threats to groundwater: Seawater inundation versus rainfall impacts

Having compared the costs of producing 1,700 kL of water per day (using Bonriki groundwater supplemented with desalinated water) under different scenarios it is possible to infer that:

- the effect of having a period of low rainfall versus a period of high rainfall is more costly than extreme seawater inundation;
- the costs of experiencing a low rainfall period relative to high rainfall period are approximately 20 times greater than the cost of extreme seawater inundation during a high rainfall period (estimated at approximately AUD 260,000); and
- during low rainfall periods, simulations suggest that the cost of extreme seawater inundation would be completely obscured by the far greater cost of low rainfall.

Given these findings, it is recommended that because policy-makers cannot change the rainfall, and that protecting groundwater from extreme inundation events is likely to cost more than the resulting benefits (reduced inundation costs), the focus instead should be on more feasible approaches to reducing the cost of supplying PUB water, such as maintaining the salinity of Bonriki to an acceptable level through continuing sustainable abstraction, protecting groundwater reserves from human pressures such as encroachment (White 2010a), and reducing leakage from water distribution pipes (Fraser Thomas Partners 2012; White 2010a).

The recommendations of this report are also supported by results in Rios Wilks (2015), where a target daily supply of 1,960 kL is used in a similar analysis that also investigates the effect of high abstraction alongside inundation and climate variability.

1. Introduction

1.1. Background

The Bonriki Inundation Vulnerability Assessment (BIVA) project is part of the Australian government's Pacific–Australia Climate Change Science and Adaptation Planning Program (PACCSAP), within the International Climate Change Adaptation Initiative. The objectives of PACCSAP are to:

- improve scientific understanding of climate change in the Pacific;
- increase awareness of climate science, impacts and adaptation options; and
- improve adaptation planning to build resilience to climate change impacts.

The BIVA project was developed by the Geoscience Division (GSD) of the Secretariat of the Pacific Community (SPC) in partnership with the Australian government and the Government of Kiribati (GoK).

1.1.1. *Project objective and outcomes*

The BIVA project aims to improve our understanding of the vulnerability of the Bonriki freshwater reserve to coastal hazards and climate variability and change. Improving our knowledge of risks to this freshwater resource will enable better adaptation planning by the GoK.

More specifically, the project has sought to use this knowledge to support adaptation planning through the following outcomes:

- Improved understanding and ability to model the role of reef systems in the dissipation of ocean surface waves and the generation of longer-period motions that contribute to coastal hazards.
- Improved understanding of freshwater lens systems in atoll environments with respect to seawater overtopping and infiltration, as well as current and future abstraction demands, recharge scenarios and land-use activities.
- Enhanced data to inform a risk-based approach in the design, construction and protection of the Bonriki water reserve.
- Increased knowledge provided to the GoK and the community of the risks associated with the impact of coastal hazards on freshwater resources in response to climate change, variability and sea-level rise.

1.1.2. *Context*

The Republic of Kiribati is located in the Central Pacific and comprises 33 atolls in three principal island groups. The islands are scattered within an area of about 5 million square kilometres. The BIVA project focuses on the Kiribati National Water Reserve of Bonriki. Bonriki is located on Tarawa atoll within the Gilbert group of islands in Western Kiribati (Figure 1). South Tarawa is the main urban area in Kiribati, with the 2010 census recording 50,182 people of the more than 103,058 total population (KNSO and SPC 2012). Impacts to the Bonriki water resource from climate change,

inundation, abstraction and other anthropogenic influences have potential for severe impacts on people's livelihood of South Tarawa. The Bonriki water reserve is used as the primary raw water supply for the Public Utilities Board (PUB) reticulated water system. PUB water is the source of potable water use by at least 67% of the more than 50,182 people of South Tarawa (KNSO and SPC 2012). Key infrastructure including the PUB Water Treatment Plant and Bonriki International Airport and residential houses are also located on Bonriki, above the freshwater lens, making it an important economic, social and cultural area for the Republic of Kiribati.

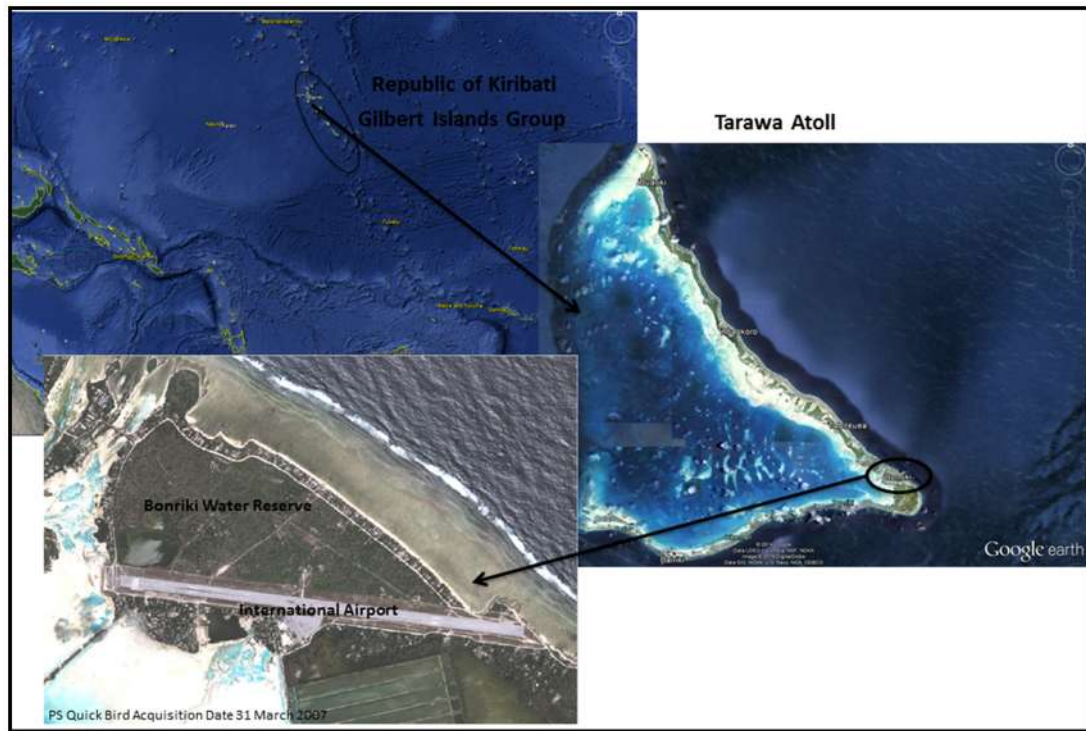


Figure 1. *Bonriki Water Reserve Location*

1.2. Purpose of this report

Using a cost–benefit framework, this analysis provides an assessment of the costs and benefits of using either rainwater or reverse osmosis desalination to fully supplement the Bonriki groundwater supply, so that a target daily water volume can consistently be produced in the face of threats to the supply. Some costs, such as effects on the environment, are currently unknown and Section 6 summarises future research and information required in order to provide a full economic analysis.

As illustrated in Figure 2, the BIVA project consisted of three interlinked components: 1) stakeholder engagement, 2) groundwater investigations and analysis, and 3) coastal investigations and analysis. This cost–benefit analysis component of the project has both been guided and supported by the technical groundwater and coastal components with information provided by stakeholders to inform the project and vice versa.

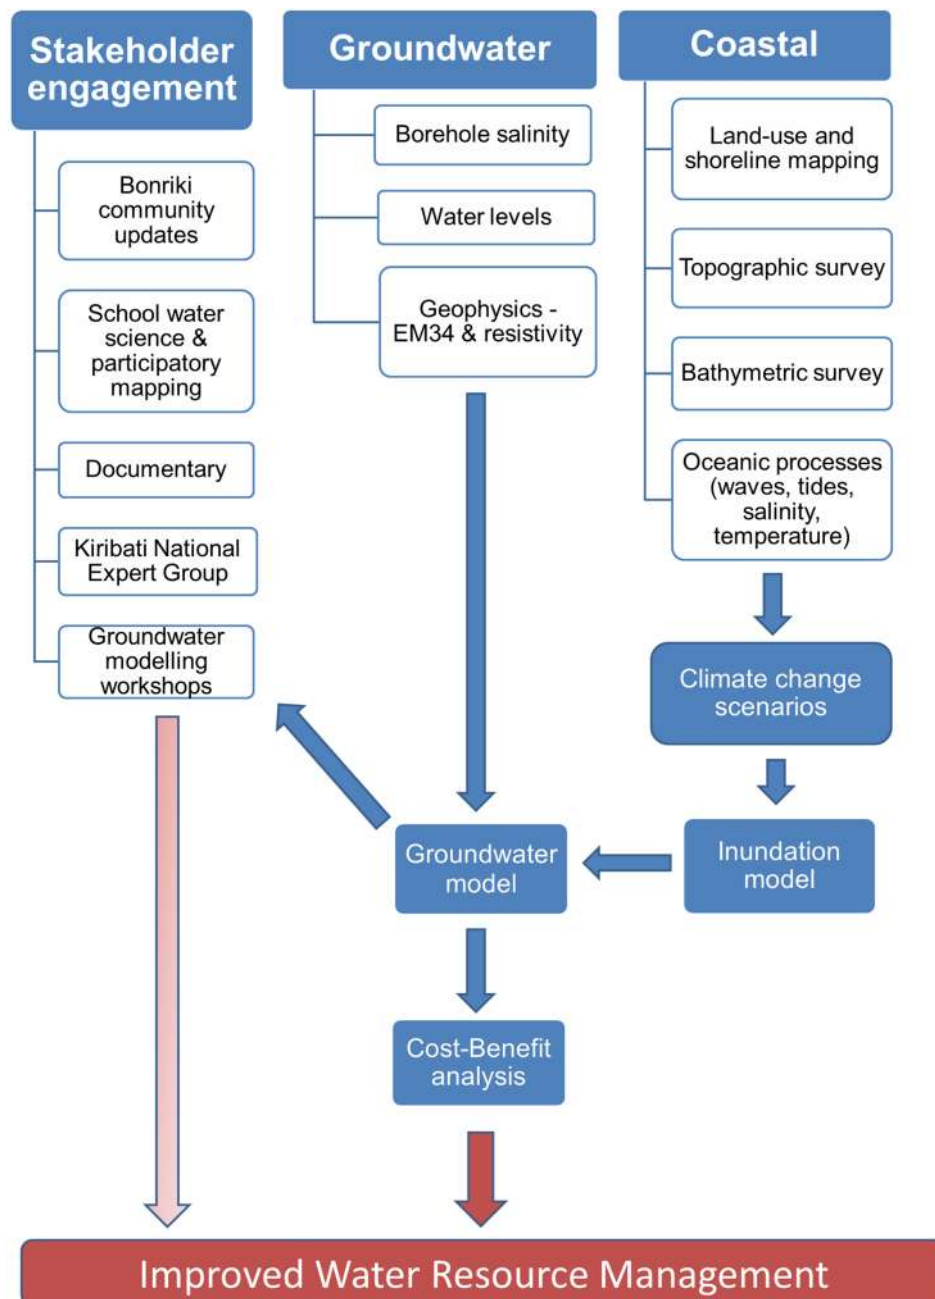


Figure 2. Bonriki Inundation Vulnerability Assessment project components

1.3. Scope of this report

This analysis will provide information to the Government of Kiribati on the potential costs, benefits and policy issues related to freshwater management options for Bonriki groundwater. The information will:

- inform public dialogue about the management of freshwater on Tarawa;
- identify data gaps needed to inform policy; and
- identify critical elements required to support policy development (enabling environment).

Section 2 provides data and background information on South Tarawa's water supply options; Section 3 explains the methodology used in the analysis; Section 4 provides the results; Section 5 discusses the implications of the results for future management; and Section 6 discusses the enabling environment for future water sources and further research required.

This report refers to the investigations and analysis undertaken as part of the groundwater and coastal components but does not seek to replicate the information within these. For detail on data collection and analysis, and processes undertaken as part of these components, refer to the other technical reports (Damlamian et al. 2015; Bosserelle et al. 2015) produced as part of the BIVA project.

1.3.1. South Tarawa background

South Tarawa is the main atoll in the Republic of Kiribati, and is the government and economic centre. It is made up of many small islets joined to form a long, thin atoll with elevations less than 5 m of current sea level¹. South Tarawa is the most densely populated atoll in Kiribati, and in 2010 was home to 50,182 people — 48.7% of the country's total population. Despite South Tarawa's limited resources, the population density is among the highest in the world; 3,184 per km² in 2010 (Republic of Kiribati 2012) and continues to rise due to inward migration from outer islands, which offer even fewer economic opportunities.

The geographical characteristics of South Tarawa coupled with it having one of the highest population densities in the world make water shortages an ever present threat for its inhabitants. Currently, the main government-provided water supply, administered by the PUB, provides 2 hours of water every 48 hours to around two-thirds of the households in South Tarawa that use groundwater lenses as their water source.

1.3.2. Economy

The main source of government revenue is the sale of commercial fishing licences. The balance of trade has been negative since 1980, and has steadily increased over time. Copra, crude oil coconut, and other coconut products make up the main export in terms of value. Fish and sea products make up the majority of the remaining export value (Ministry of Statistics, pers. comm. 2013). Aside from fresh fish and the few local produce that can grow in Tarawa's soil, food is imported. The value of food imports is greater than any other import group, followed by machinery and transport equipment and mineral fuels.

Although there is one tuna processing factory that operates in Betio, there is little industry in South Tarawa. Two-thirds of the labour force is out of work or engaged in subsistence activities (Republic of Kiribati 2012). Subsistence fishing is particularly important. Currently, there is minimal agriculture in South Tarawa, the only nonsubsistence producer of vegetables is the Taiwanese Technical Mission farm, which educates communities in how to grow crops and supplies a few local shops with produce. Urban households typically grow only pawpaw (papaya) and breadfruit (KNSO and SPC

¹ According to topographic survey data produced by the Secretariat of the Pacific Community in 2014.

2012). The main industry in which the population is formally employed is the tertiary sector, which is public administration and services (KNSO and SPC 2012).

1.3.3. Climate change challenges

In addition to the challenges South Tarawa faces concerning population and resource limitations, the atoll is highly susceptible to impacts of climate change. As with most low lying atolls, sea-level rise is of great concern. Average sea-level rise around Kiribati has been on the order of 1–4 mm per year since 1993 (CSIRO 2011), gradually encroaching on shoreline properties. Two other natural hazard threats faced by Tarawa are drought and seawater inundations. Although Tarawa lies outside the cyclone belt, seawater inundations do occur and can be further exacerbated by El Niño–Southern Oscillation effects on the sea level (World Bank undated). Seawater inundations have been recorded for 2014 and 2002 in Tarawa, the former led to evacuation and 44 houses being damaged, the later was estimated to cost around USD 50,000 (approx. 60,000 AUD) in damage (PDalo 2013).

1.3.4. Dual threats to the water supply

Being a coral formation, land in Tarawa is porous and no surface water exists. Water comes instead from variety of sources, particularly rainwater harvesting or bores (groundwater from a freshwater lens) (Republic of Kiribati 2012). In the latter case, clean and treated groundwater relies heavily (although not entirely) on the Bonriki freshwater reserve (Republic of Kiribati 2012) which feeds into the government water supply system. The groundwater lens is an unconfined aquifer composed of coarse carbonate sands and underlain by reef limestone that make up the islet's substrates. Bonriki airport is located on the land above the Bonriki freshwater lens (Figure 3 and Figure 4).



Figure 3: Bonriki area

Source: One World Nations Online, 2015

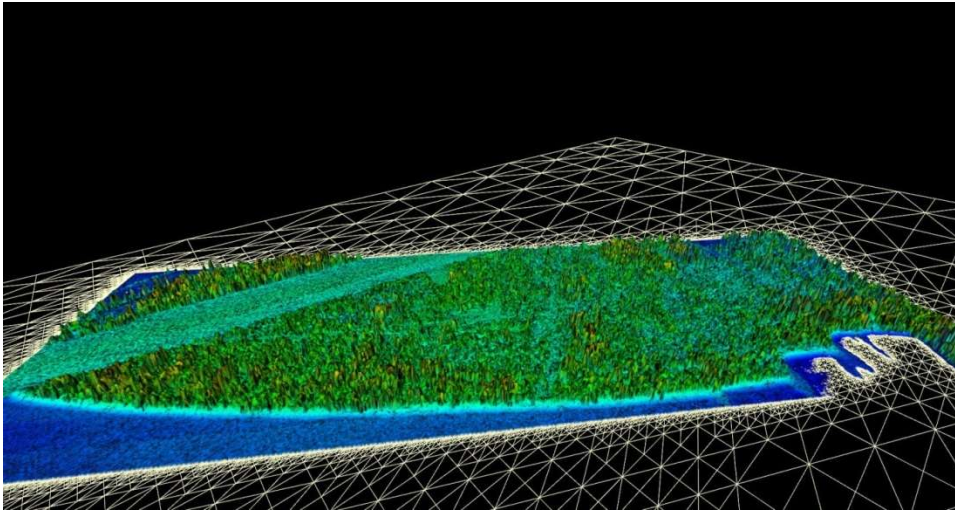


Figure 4: Computer generated image of Bonriki freshwater reserve

Source: Damlamian, SPC 2014

Unfortunately for residents of Tarawa, groundwater presently cannot meet all the demands for water. Moreover, the groundwater lenses are a fragile resource of limited extent. Threats to ongoing supplies from groundwater can be categorised into natural and human induced threats.

Natural threats

- Variations in rainfall: Low rainfall and the consequent low recharge of lenses with freshwater are expected to put pressure on the supply of freshwater to South Tarawa's population (Bosserele et al. 2015).
- Saltwater intrusion: Intrusion arising from wave overtopping and seawater inundation along with over abstraction is expected to have implications for the volume of palatable freshwater that can be pumped out of Bonriki lenses to supply residents of South Tarawa. Under the BIVA project, three-dimensional numerical groundwater modelling has been undertaken to assess the impacts of wave overtopping events (seawater inundations) on Bonriki freshwater supplies. Results of the modelling are used in this analysis to provide insight into the management of the reserve.
- Evapotranspiration: Groundwater lost via evaporation and transpiration from vegetation (White 1996, 2010a).

Human induced threats

- Overabstraction (exacerbated by water losses): Accommodating the huge population leads to high abstraction rates even during dry periods. White et al. (2008) note that overabstraction poses a threat to freshwater lenses. Water loss through the PUB distribution system has also frequently been cited as a significant issue (Fraser Thomas Partners 2012; White 2011a; White et al. 2008). All water produced from groundwater lenses is distributed via the PUB piping system but a large proportion of water is lost before it reaches consumers. These losses cause higher abstraction rates to be required in order to supply the population.

- Encroachment onto groundwater reserves: Population increase has left reserves vulnerable to human settlement and contamination of groundwater lenses below (White et al. 2008).

These factors could cause the salinity of the Bonriki groundwater to surpass the 1,500 $\mu\text{S}/\text{cm}$ threshold limit for freshwater provided to the community from the public water supply system, at which point it is considered unpalatable.

1.3.5. Existing water initiatives

The National Adaptation Program of Action for Kiribati 2007 has specific objectives for water resource adaptation:

- Maintain and conserve available good groundwater lenses.
- Gain users' confidence in the reliability of the distribution system and promote their willingness to pay, based on consumed quantity.
- Increase water storage and water resources to meet current demands and at times of serious droughts.
- Manage risks to water resources throughout the atolls.
- Assess impacts of urban water supplies on other natural resources, systems and subsistence activities.

Since 2007, the Tarawa Water Master Plan (TWMP) for Kiribati was produced by White (2011a). The plan evaluates a variety of management options that address the supply and demand challenges for freshwater in the whole of Tarawa. The TWMP takes into account many different water sources and management options for Tarawa, making recommendations to the government on the most efficient overarching strategy for increasing the availability of freshwater on Tarawa. The report identifies that human factors are expected to produce the greatest threat to Tarawa's water supply over the next 15 years, while noting the high levels of water leakage within the present system:

"...the most significant threat to the availability and quality of freshwater in South Tarawa is its ever-increasing population".

"A major problem in meeting current water needs in South Tarawa is the estimated 50% losses of water from the reticulation [lens water distribution] system, and particularly from the domestic system. Reducing this excessive leakage and addressing the underlying causes should be highest priority. There is no point in introducing new water sources into South Tarawa if leakage rates are not reduced."

1.3.6. This report

While bearing in mind the existing research and programmes currently underway, this analysis focuses primarily on the least costly method of providing supplementary freshwater while taking into account one of the lesser studied threats: the threat to Bonriki from seawater inundation. Rainwater variation is also included in the analysis in order to understand the magnitude of seawater inundation treats relative to other factors. This report should be read in conjunction with the other economic analysis report, which considers the impact of higher abstraction rates to the lens (Economic analysis of water management options for impacts from inundation, climate variability and high abstraction rates, Bonriki water reserve, South Tarawa, Kiribati (Rios Wilks 2015).

2. Data and background information

2.1. Tarawa current water sources

There are four main water sources in Kiribati: rainwater, piped water (freshwater lens), well water, and bottled or other water (Table 1).

Table 1: Percent of households using each water source.

Location	Rainwater	Pipe system (freshwater lens)	Well water	Bottled or other
South Tarawa	9 %	67 %	23 %	< 1 %
North Tarawa	1 %	2 %	97 %	< 1 %

Source: Calculated from the 2010 Kiribati census report (KNSO 2010).

2.1.1. Private groundwater and bottled water

White (2010a) rejects the notion of private groundwater wells as a source of safe drinking water around Tarawa because of their historically high frequency of contamination. The potential of private groundwater wells as a means to supplement water supplies is, therefore, not considered in this analysis. In the case of bottled water, statistics from the 2010 census (KNSO 2010) suggest that less than 1% of the population use bottled water. The low contribution of this source to water supplies is no doubt related to the high cost of this source, coupled with the large volumes of water required by the government to supply the population. Together, these factors render this source impractical for use as a backup to the Bonriki reserve and the potential for it is, therefore, not included in this analysis.

2.1.2. Household rainwater harvesting

Although around 40% of households use rainwater as one of their freshwater sources, low roof catchment area capacity, large family sizes and frequent (approx. every seven years) droughts related to the El Niño–Southern Oscillation make this source unreliable (White 2010b). Consequently, Metutera (2002) and White (2010a) have recommended that household rainwater harvesting should be thought of as a supplemental water supply, rather than as a regular supply. No survey has yet been undertaken to record the current capacity for rainwater harvesting, making estimation of harvesting potential difficult. White (2011a) has estimated that, historically, the cost of household rainwater has been approximately AUD 8.2/kL. At first glance this seems high compared with the AUD 3.6/kL cost of production (abstraction) of water from the Bonriki reserves (White 2010a). Nevertheless, the cost of production from the groundwater lenses does not take into account the water lost through the distribution system before reaching households. Once these losses are taken into account, the cost of supplying water from Bonriki is actually higher per unit of water, rendering the cost of rainwater harvesting more competitive. The fact that household rainwater cannot produce all the necessary water does not mean that household rainwater harvesting should not be pursued. If properly maintained, rainwater harvesting systems using

building roof areas have been estimated to be able to produce around 5 L/person/day for their inhabitants, with only a small risk of failure (White 2010a). This is enough to provide a third of the Sphere Standard (The Sphere Project 2014) total basic water need of a person².

Another potential reason for low rainwater harvesting levels is that groundwater has been the traditional choice when making coconut toddy compared with rainwater (White 2010a) because the use of rainwater alters the taste unfavourably. This means that in some instances groundwater may be used even when clean rainwater is available, re-enforcing the need for quality groundwater. Nevertheless, the value of rainwater as a safe source of water for normal drinking and cooking activities cannot be disregarded and it is likely that with awareness raising and the increasing salinity of ground water, there may be future changes in taste preference.

2.1.3. Freshwater lenses

The Bonriki and Buota lenses feed the government-piped water system and supply approximately 67% of the households in South Tarawa according to the 2010 census. White (2010a) calculates the current unit cost of production for Bonriki and Buota to be AUD 3.60/kL. The water supply is managed by the PUB.

The water provided from Bonriki and Buota lens cannot supply all households in South Tarawa. Excess demand for water means that in 2005 over 40% of households used rain water and over 70% used wells as a source of water in South Tarawa. North Tarawa relies almost exclusively on open wells. Nevertheless, as discussed in White (2010a), previous studies have deemed household well water unsafe to use for bathing, cooking or drinking.

In addition to the ever greater demand on groundwater reserves from the population, coastal hazards such as wave overtopping, produce risks of seawater inundation and contamination. With average sea-level rise in Kiribati having been around 1–4 mm per year since 1993, and with further sea-level rise predicted over the next century (CSIRO 2011), and increasing demand for freshwater places additional stress on available groundwater, and saltwater intrusion is likely to become an ever greater threat to these vital water resources.

2.2. Alternative water sources

If Bonriki is unable to provide the target water volume after a seawater inundation or due to overabstraction, the PUB would be required to supplement the production.

White's (2010a) extensive assessment of other possible water sources provides an excellent source of information for choosing the least costly alternative water supply for use in this analysis. White (2010a) calculates the current unit cost of production for Bonriki to be AUD 3.60/kL, and notes that the Bonriki lens source is the cheapest source per unit because the installation costs have already been incurred, leaving only the operating and maintenance costs to fund. Metutera (2002) also shared this conclusion.

² Between 7.5 L and 15 L of safe water per day

One of the least costly alternatives suggested by White (2010a) is reverse osmosis desalination. Despite the potentially high unit production costs of running the desalination plant over short time spans, this source is put forward in this analysis as one of the least costly options open to the government. The government has also asked for rainwater to be assessed for its cost effectiveness.

2.2.1. Desalination

If the salinity of the water increases to a point where it renders groundwater unsuitable for consumption, it may become necessary to consider the use of reverse osmosis desalination of seawater, as concluded by the TWMP (White 2010a). Although desalination plants in the Pacific do not have a successful history (White 2010a), following the installation and operating of the plant in Nauru, it is possible that — if the operation and maintenance of the plant is contracted out to experienced international suppliers — reasonable service and maintenance might be sustained. An economic analysis of the value of this option would require information on the type of plant that would be most suitable and the cost the government would need to incur to implement and maintain it. White (2010a) recommends reverse osmosis desalination as one of the least costly ways to increase water supply; nevertheless, compared with groundwater, desalination is expensive. Although there is no cost breakdown by White (2010a), estimates vary between AUD 5.19/kL and AUD 21.79 /kL. This upper bound cost estimate is similar to the cost of small-scale desalination in Tuvalu, which produces 50 kL/day at a unit cost of around AUD 17/kL (Gerber et al. 2011).

Metutera (2002) estimated that the costs (Table 2) involved in producing water from the reverse osmosis desalination plants first installed in Kiribati during the 1999 drought. The costs are based on PUB’s reported costs during the first two years of operation.

Table 2: Previous desalination experience.

Description	AUD	Comment
Fixed costs Implementation costs for two plants with combined daily capacity of 110 kL	300,000	Includes purchase of plants, construction of the building housing the plant, and of the saltwater intake well and the labour costs.
Variable costs Electricity costs / kL	2.81	Must be magnified to account for the increase in real price level of energy since 2002.
Labour costs/kL	1.84	-
Replacement parts/kL	0.73	-
Total variable costs/kL	5.38	-

Source: Metutera 2002

More recently, Fraser Thomas Partners (2012) detailed the cost of reverse osmosis desalination in South Tarawa, reporting that the unit cost of water in their intervention scenario would be approximately AUD 4.50/kL, the long durable life of the units allows its cost estimate to sit at the lower end of White’s cost range. Although the full economic costs of desalination are not covered, this analysis of desalination potential on Tarawa specifically is the most detailed in terms of its attention to detail in the running of the plants and consequently it is used as the basis for desalination costs in this analysis. Using the cost break down in the Fraser Thomas Partners analysis appendix, it is possible to generate costs based on the scenarios and assumptions of this analysis.

The Fraser Thomas Partners costs are altered to account for more recent energy price projections discussed below (OPEC 2013) and any differences in the volume of water required.

The Fraser Thomas Partners desalination units are built with an expected life of 30 years or more (if pumps, valves and chlorine units are replaced and the units are properly maintained by contracted engineers). All of these costs are also included in this analysis.

Harrison Grierson Consultants (2013) in their peer review³ of Fraser Thomas Partners (2012), agree that reverse osmosis desalination is the least costly option and with the general technical aspects of reverse osmosis desalination assumed. Suggestions were made to use fewer, larger plants at a central site rather than the multiple plant set-up evaluated by Fraser Thomas Partners in order to further reduce operating costs. It was also suggested that full contracted maintenance be budgeted for the lifetime of the plants in the case that the PUB is unable to manage the task. In addition, the environmental aspects of the implementation would also need to be evaluated. These suggestions and the implications for the cost of producing water are discussed in the sensitivity analysis section. Importantly, the review also noted that the costs associated with deconstruction and recycling of the old desalination plants after 30 years was not included in the Fraser Thomas Partners evaluation. Because of the significance of this omission, this analysis includes an extra 'disposal cost' in the baseline estimations.

2.2.2. Fuel and electricity costs

A high proportion of desalination costs are due to the high energy supply they demand. A Kiribati PUB report (Metutera 2002) finds that the electricity cost of supplying groundwater is only AUD 0.17/kL whereas that of running the desalination plants was AUD 2.81/kL. Energy costs have been found to make up between 30% and 60% of desalination production costs, with heat processes such as those used in reverse osmosis desalination needing more energy (Pacific Institute 2006). The PUB supplies energy to the grid through diesel fuel generators (Republic of Kiribati 2012) and it is likely that in Kiribati, energy costs will continue moving with the cost of crude oil. Information on the cost of importing fuel per barrel by Kiribati or the source of their imported fuel is not available, and consequently this analysis uses the Organization of the Petroleum Exporting Countries (OPEC) long-term oil price forecast (OPEC 2013). Their analysis of the demand and supply of world oil based on the OPEC reference basket lead to a prediction of a slight downward movement in real price of oil from USD 104/barrel in 2015 to USD 100/barrel in 2035. This amounts to a negligible annual price change; nevertheless, oil prices have recently fallen dramatically, indicating the volatile nature of this commodity price. Given the magnitude of uncertainty surrounding long-term oil prices, this analysis will assume a constant real energy price. Changes in fuel price are discussed in the sensitivity analysis.

³ The peer review was produced for the use of the Pacific Infrastructure Advisory Centre only, and advises that only indicative costs can be inferred from the report. Nevertheless, omitting reference to the report and producing estimations based solely on the Fraser Thomas report would be irresponsible. Consequently, its comments are discussed and used to check the robustness of results in the sensitivity analysis section.

2.2.3. Large-scale rainwater harvesting

The second water supplementation option being considered in this analysis is rainwater harvesting. In order to make a fair comparison with the option of desalination, large scale harvesting (able to produce 1,700 kL/day when the salinity of Bonriki surpasses the limit) will be estimated. This would consist of purpose-built, large-scale rainwater harvesting as detailed in White (2011a). White (2011a), using a rainwater tank calculator estimated the size of catchment area and tank size required in order to reduce the risk of water supply failure to zero percent. A roof area of 100 ha and a tank volume of 600,000 kL would be needed in order to supply 2,000 kL per day. In addition, in order to be able to construct purpose-built catchments of this size, it is likely that the government would need to rent land from inhabitants or pay compensation to landowners, which would further increase the cost of this option. These additional costs are unquantified in this analysis but are summarised in Table 5 of the methodology section.

The magnitude of the required catchment area and storage capacity are due to the high degree of variability on rainfall on Tarawa. In order to deal with severe droughts, shown to be correlated with the El Niño–Southern Oscillation (White and Falkland 2009), it is necessary for the rainwater infrastructure to be able to capture and store sufficient amounts of water during normal rainfall times in order to provide enough water through drought periods. This characteristic makes reliable rainwater harvesting (able to consistently supply water through droughts) relatively expensive compared with harvesting in locations where rainfall is less varied.

2.3. The daily water production target

The daily water production target used in this analysis is 1,700 kL/day. This volume of water is approximately equal to the current abstraction rate at Bonriki and similar to current estimates of sustainable yield for Bonriki of 1,660 kL/day. The analysis assumes that this volume is produced at all times via Bonriki supply, desalination or rainwater. Analysis of the economic impacts to the water management options from a higher abstraction rate can be found in Rios Wilks (2015).

2.3.1. Putting the production target in the context of South Tarawa's population

The total demand for water on Tarawa is a function of the total population services and the quantity they are allocated per day. In Tarawa, the GoK has adopted an exponential growth rate model⁴ for the expected future population of the atoll. Using this model with data from the last two censuses the mean annual percentage exponential growth rates for the period 2005 to 2010 is calculated and displayed in Table 3.

⁴ Model is defined as: $P_t = P_0 \cdot e^{rt}$. Where P_0 is population in the base year, P_t is the population t years after the base year, r is the growth rate, and e is Euler's number.

Table 3: Kiribati population in 2005 and 2010, and the forecasted population for 2015.

Region	Total population in 2005 ⁵	Total population in 2010 ⁶	Mean annual exponential growth rate		Total population forecast for 2015	
			Upper	Lower	Upper	Lower
South Tarawa	40,311	50,182	4.38%	2.15%	62,470	55,890
North Tarawa	5,678	6,102	1.44%		6,558	

These growth rates are very similar to those calculated independently by (White, 2010) and as reported in ADB (2014). In practice, growth rates of this level could not continue in perpetuity. This is because of land and resource constraints on Tarawa and the already existing high population density. Given this, a more realistic lower bound growth rate is also calculated. This lower growth rate assumes zero net inward migration to South Tarawa (the national growth rate is used).

At present, using the lower bound 2015 population forecast, the target water production is sufficient to supply South Tarawa’s population with approximately 30 L of water/person/ day only if 100% of the water produced reached consumers. In actual fact, the distribution system is expected to have around 50% losses (Fraser Thomas Partners 2012; White 2010a). Given an optimistic approximate water loss of 25% during the distribution process, the volume reaching consumers would be expected to be around 23 L/person/day. With the 50% losses expected, the supply may be only 15 L/person/day.

The approximately 15 L/person/day that the target volume is expected to supply using the 2015 population forecast and 50% water distribution losses is below the 21 L/person/day, which constitutes ‘basic access’ to water under the World Health Organization standards (WHO 2006), but meets the minimum (Table 4) global Sphere standard (The Sphere project 2014). The Sphere standard has calculated the average minimum daily requirement for water which enables populations to maintain health. Currently, the total basic water needs per person have been set at between 7.5 L and 15 L of safe water per day, depending on the environment in which the population lives. Given Tarawa’s location, which is almost directly over the equator, and its consequent climate, the maximum bound of 15 L/person/day could be used to represent the minimum water volume that should be provided to each inhabitant.

⁵ Source: National Statistics Office 2005

⁶ Source: National Statistics Office and SPC2010

Table 4: Total basic water needs according to the Sphere standard.

Survival needs: water intake (drinking and food)	2.5–3 litres per day	Depends on the climate and individual physiology
Basic hygiene practices	2–6 litres per day	Depends on social and cultural norms
Basic cooking needs	3–6 litres per day	Depends on food type and social and cultural norms
Total basic water needs	7.5–15 litres per day	

Source: <http://www.spherehandbook.org>

Nevertheless, the target is still below the volume demanded by the population. White (2010a) estimated the average daily water demand per person to be 60 L/person/day based on survey information taken from Kiritimati Island villages and the village of Nonouti.

Looking to the future, even when using the lower growth rate and only a 25% loss of water during distribution, by 2036 the Bonriki freshwater reserve would be unable to provide the minimum global Sphere standard of 15 L/person/day.

3. Methodology

3.1. Analysis methodology

According to preliminary models generated by the BIVA project (Bosselle et al. 2015), storm surges, variation in rainfall, and different abstraction rates all affect the volume of water available from the Bonriki groundwater reserve each year. In circumstances where Bonriki cannot supply water below the salinity threshold, other sources of water will be required. Although the Buota lens supplies approximately 15% of the total combined water provided to South Tarawa from PUB, the BIVA project focused on the Bonriki lens only and this analysis does the same (i.e. excludes Buota from the calculations).

Objective of the analysis: Based on preliminary findings from BIVA groundwater models (see Annex 1), this analysis used a cost–benefit framework to estimate the most cost-effective way of providing additional water to supplement Bonriki’s groundwater supply over the next 10, 20 and 50 years, taking into account the effect of seawater inundations and rainfall (the effects of which are captured in four illustrative scenarios, described in the next section).

Methodology: To determine the most cost-effective way of providing additional water, the analysis evaluates two water sources that could be used to supplement the groundwater supply; large-scale rainwater harvesting or reverse osmosis desalination. The analysis estimates the expected future

cost of producing supplementary water via either desalination or rainwater so that the target water production (1,700 kL/day⁷) is always reached, under the four illustrative scenarios. By comparing the cost of production in each scenario it is then possible to estimate the cost of an extreme seawater inundation event and rainfall variability on the PUB water supply based on existing groundwater models (Bosserele et al. 2015).

3.1.1. Benefits and costs of water sources

The benefits of a maintained water supply are largely the same, regardless of the origin of the water (groundwater, large-scale rainwater or desalination). Benefits of the government producing sufficient supply for the population include cost savings from not having to import water from overseas or disruptions to the economy if the supply was to fall short.

On the other hand, costs vary between the two options, as indicated in Table 5. Costs marked in blue are unquantified in this analysis. Further work is required to determine these costs, but the expected impact of some of these unquantified costs is discussed in the sensitivity analysis.

Table 5: Costs of water production options.

	Large-scale rainwater harvesting	Desalination
Quantified	<ul style="list-style-type: none"> - Infrastructure and construction - Maintenance and labour 	<ul style="list-style-type: none"> - Infrastructure and construction - Maintenance and labour
Not quantified	<ul style="list-style-type: none"> - Effect on supply of rainwater to groundwater lenses - Compensation to landowners/rent if private land required - Legal costs of negotiating the use of scarce land - Operational costs enforcing access rules to the resource, particularly if large-scale rainwater harvesting relies on a distributed system or approach. - Distribution costs via the Public Utilities Board system 	<ul style="list-style-type: none"> - Environmental impacts - Importing fuel increases trade balance deficit - Sensitivity to fuel price fluctuations - Distribution costs via the Public Utilities Board system

3.1.2. Quantitative indicators

This analysis will estimate the net present value of total costs (net present cost, NPC) of producing water via rain capture or desalination in the representative scenarios used in this study. The NPC shows the cost of using either form of water supply over the period analysed, and is expressed in present day values. Costs per unit are also estimated, for ease of comparison with other water

⁷Approximately equal to the current abstraction rate for Bonriki. It is assumed that 1,700 kL/day is the minimum volume of water that must be supplied to the population at any point in time in any analysis scenario.

sources. Due to the range of discount rates used in the Pacific and the impact they can have on results, cost estimates are calculated using four different discount rates (10%, 8%, 3% and 0%, i.e. no discounting).

3.2. Modelling scenarios

The BIVA project has produced a wide range of seawater inundation scenarios under different wave height and water level predictions. As summarised in Annex 2, inundation scenarios consider the impact of predicted water level and wave heights occurring on sea levels predicted in 50 years (i.e. 2064), under three different greenhouse gas emission scenarios.

- Medium emission scenario (RP6) with sea level rise projection for 2064 (PACCSAP 2014).
- High emission scenario (RP8.5) with sea level rise projection for 2064 (PACCSAP 2014).
- Intermediate-high emission scenario from the US National Oceanic and Atmospheric Administration (Parris 2012)

To provide an indication of the impacts on the salinity of the Bonriki freshwater lens resulting from inundation, four representative scenarios were developed for the groundwater model. They include consideration of two variables: extreme inundation impact versus no inundation; and wet (high) versus dry (low) rainfall conditions. The salinity of the water leaving the groundwater treatment plant via the trunk main is calculated from the groundwater model to allow comparison over time of the impacts on the groundwater supply in response to the different scenarios.

The model was run for a period of 17 years (6,208 days) (either with or without an intrusion event occurring at the start of the period) to determine the impact on the Bonriki freshwater lens and its recovery under different climatic conditions and at an abstraction rate of 1,700 kL/day. Salinity estimates of the water leaving the trunk main at the groundwater treatment plant for four representative scenarios of inundation and rainfall were produced. Using these scenarios, the proportion of time that the salinity of Bonriki is above the 1,500 $\mu\text{S}/\text{cm}$ threshold was estimated.

3.3. Finding the least costly source of supplementary water

This analysis looks to find the least costly way to supplement the Bonriki water supply, either via reverse osmosis desalination or rainwater so that the daily target of 1,700 kL is produced at all times. When the Bonriki groundwater salinity is above the 1,500 $\mu\text{S}/\text{cm}$ threshold, the alternative sources (either rainwater or desalination) must supplement the supply to reach the target volume. Given the four scenarios modelled, the proportion of time that the alternative sources are required and the volume of water they are required to produce, is calculated and displayed in Table 6 and Figure 5. Proportions are based on the 17 years of analysis produced by Bosserelle et al. (2015). Because the economic evaluations span different time periods (50, 20 and 10 years), these proportions are used in order to calculate the number of days per year that Bonriki's salinity is above 1,500 $\mu\text{S}/\text{cm}$.

Table 6: Scenarios and groundwater impact.

Scenario	Rainfall ⁸	Seawater inundation	Daily abstraction rate from Bonriki (kL)	Number of days from the 6,208 days that the water will be >1,500 µS/cm salinity limit	Proportion of time that salinity >1,500 µS/cm	Daily volume sourced via alternate means (desalination or rainwater) when Bonriki salinity >1,500 µS/cm
1	Wet (High)	No inundation	1,700	395	6%	1,700
2	Dry (Low)	No inundation	1,700	4,984	80%	1,700
5	Wet (High)	Extreme inundation	1,700	627	10%	1,700
6	Dry (Low)	Extreme inundation	1,700	4,984	80%	1,700

In other words, in each scenario it is assumed that the salinity patterns produced by Bosserelle et al. (2015) are repeated every 17 years. Using these groundwater model estimates, the proportion of time that salinity is above the threshold was used in 10, 20 and 50-year analyses and is displayed in Table 6.

Table 6 shows the expected number and proportion of days that Bonriki’s water will be greater than the 1,500 µS/cm salinity limit (columns 3 and 4). During this time, the supplementary sources would be required to produce water. Interestingly, as can be observed in scenario 1, even without any inundation and during a wet (high rainfall) period, Bonriki’s groundwater surpasses the salinity limit 6% of the time. This is because abstraction also plays a role in determining salinity levels because abstraction rates increase the proportion of time that salinity is above the threshold increases (holding other factors constant). Analysis of different abstraction rates can be found in the other BIVA economic analysis (Rios Wilks 2015).

In each scenario, the total volumes of water produced by either Bonriki or one of the supplementary sources is calculated and displayed in Figure 5.

⁸ See Bosserelle et al. (2015) for rainfall assumptions.

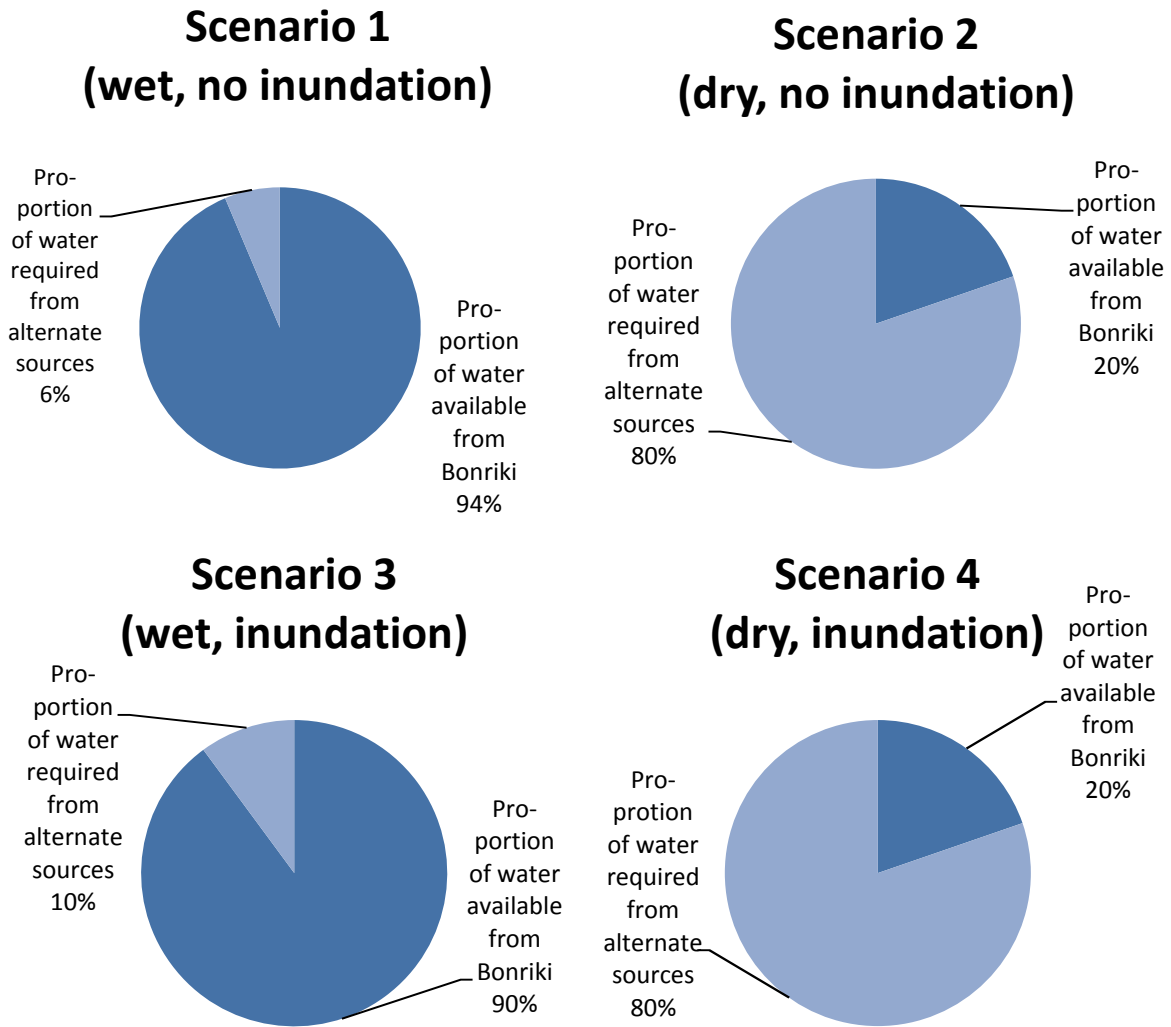


Figure 5: Expected water requirements under the scenarios (total volumes over 6,208 days modelled).

3.4. Evaluating the significance of threats to the groundwater supply

The cost of providing the water target in each scenario is estimated for the 17-year period modelled by the groundwater team. By comparing these costs of topping up the groundwater supply in different scenarios, it is possible to estimate the magnitude of the different threats in terms of the cost of producing the target water volume.

- **Cost of seawater inundation during high rainfall period:** The cost of seawater inundation can be estimated by calculating the cost of scenario 3 over the 17-year period minus the cost of scenario 1 over the 17-year period.
- **Cost of seawater inundation during low rainfall period:** The effect of seawater inundation on cost can be estimated by calculating the cost of scenario 4 over the 17-year period minus the cost of scenario 2 over the 17-year period.⁹
- **Cost of reduced rainfall:** The effect of having a low rainfall period rather than a high rainfall period can be estimated by calculating the cost of scenario 2 over the 17-year period minus the cost of scenario 1 over the 17-year period.

3.5. Summary of analysis assumptions

All assumptions made in the analysis are summarised in the tables below (Tables 7 to 9). All values are in 2014 prices. The effects of changing the assumptions are discussed in the sensitivity analysis section.

⁹ Even without undertaking any calculation, from the above table it is possible to see that the cost of a seawater inundation in dry conditions is zero. The inundation impact to salinity is so small compared to that of the rainfall that it has no additional effect on the number of days which Bonriki is above the 1,500µS/cm salinity limit.

Table 7: Summary of general analysis assumptions.

Analysis component	Assumption
Target water production	A target of 1,700 kL/day is used, estimated to be the current abstraction rate for Bonriki. This is the volume of water that must be produced via either Bonriki groundwater, rainwater or desalination.
Seawater inundation impacts on Bonriki groundwater supply	The seawater inundation and groundwater models used to produce the data for this analysis (Damlamian 2015; Bosserelle et al. 2015) have incorporated expected sea-level rise under different greenhouse gas emissions for the next 50 years.
Water sources	Bonriki water reserve is the primary water source. When it is unable to provide the 1,700 kL/day, one of the alternate sources is used to top-up water production to this amount.
Import prices (imported goods required for infrastructure construction)	No change in exchange rate is assumed (shadow exchange rate factor = 1). Fossil fuel prices (and consequently costs of transport) are held constant in real terms (OPEC 2013).
Local labour	Any costs incurred due to paying for local labour is adjusted to account for the 20% income tax. A shadow wage rate of 90% is used to account for the loose labour market in South Tarawa (see Section 1 for a brief overview of the economy).
Social discount rate	Discount rates of 10, 8, 3 and zero per cent are employed for robustness.
Costs are calculated in real terms	It is assumed that the costs indicated in the cost breakdown in Fraser Thomas Partners (2012) analysis are in real, constant 2012 prices.

3.5.1. Large-scale rainwater harvesting

Table 8 details the assumptions made for large-scale rainwater harvesting. The required roof area and tank volume are from White (2011a) and are calculated based on the White and Falkland 2009 water model (runoff coefficient = 0.85, rainfall based on 1947–2008).

Table 8: Large-scale rainwater harvesting assumptions.

Analysis component	Assumption
Cost of large-scale roof catchment area required (85% of White 2011a cost for producing 2,000 kL/day).	91.6 million
Large water harvesting roof area life expectancy (maximum).	50 years
Cost of large-scale rainwater tanks per kL storage (85% of White 2011a cost for producing 2,000 kL/day).	54.9 million
Life expectancy of tanks and guttering (White 2010b).	20 years
Cost of installation, guttering and fittings as a percentage of tank costs (minimum).	20%
Approximate average annual salary of full-time staff (Tanaea Facility, Government Ministry of Agriculture and Livestock).	4600
Income tax (Fraser and Thomas Partners 2012).	20%
Weekly wage of rainwater caretaker (20% income tax deducted).	71
Shadow wage used to account for loose labour market (high unemployment).	90%
Resilience of rainwater harvesting and desalination activities to natural hazards.	It is assumed that the threat of sea-level rise and seawater inundation be taken into account when deciding on the location of the constructed large-scale water catchment and desalination plants.
Rainwater capture	As with the reports on which the rainwater infrastructure data for this analysis is based, rainfall conditions are those used for the White and FalkLand (2009) water model (runoff coefficient = 0.85, rainfall based on 1947–2008).

3.5.2. Desalination

Table 9 details the assumptions made for desalination. Values are based on Fraser and Thomas Partners (2012) and Harrison Grierson Consultants (2013).

Table 9: Desalination assumptions.

Analysis component	Assumption
Installation cost/daily kL plant capacity	5,117
Yearly running cost/daily kL plant capacity	1,122
Cost of replacement of pumps and valves every 15 years	2,084,864
Cost of replacement of clor units (Fraser Thomas Partners 2012) every 10 years	62,546
Life expectancy of plants	30 years
Disposal and recycling of desalination plants	An additional 100% of the implementation costs is added on the 30th year to account for the costs associated with disposal of the exhausted equipment

4. Results

The results of the analysis are split into three sections (A, B, C) for easier understanding of the various findings.

4.1. (A) General cost estimates (if rainwater or desalination was required to produce 1,700 kL every day, 100% of the time)¹⁰

Before analysing the costs of water production under the six representative scenarios, general cost estimates for producing at least 1,700 kL of water per day via rainwater or desalinated water are calculated.

These estimates show the costs of producing water from each source if they were required to produce at their maximum capacity at all times. These estimates represent the standard costs of production from each water source, comparable with production costs found in the literature for studies evaluating the cost of producing additional water for Tarawa. As with the reports on which the rainwater infrastructure data for this analysis is based, rainfall conditions are those used for the White and Falkland (2009) water model (runoff coefficient = 0.85, rainfall based on 1947–2008).

¹⁰ All cost estimates are indicative, preliminary cost estimates produced for the Secretariat of the Pacific Community, Pacific–Australia Climate Change Science and Adaptation Planning, Bonriki Inundation Vulnerability Assessment project. In order to fully cost water sources, additional data and considerations must be addressed as described in Section 6.

Table 10 displays the NPC and the unit cost (cost per kL) of water produced from each source if production was required to take place for 50 years, 20 years or 10 years with the water from all sources being utilised. Estimates are shown for four discount rates (10%, 8%, 3% and 0%).

Table 10: General cost of production for large-scale rainwater harvesting (LSRH) and desalination, in Australian dollars.

	LSRH	Desalination
Volume produced per day (kL)	1,700	1,700
50-year evaluation		
NPC (10% discounting)	169,135,884	38,551,569
Average unit cost (10% discounting)	5.45	1.24
NPC (8% discounting)	175,089,243	45,623,189
Average unit cost (8% discounting)	5.64	1.47
NPC (3% discounting)	214,818,803	87,638,522
Average unit cost (3% discounting)	6.92	2.82
Total cost (no discounting)	290,327,348	162,435,498
Average unit cost (no discounting)	9.35	5.23
20-year evaluation		
NPC (10% discounting)	157,831,165	33,267,127
Average unit cost (10% discounting)	12.71	2.68
NPC (8% discounting)	157,835,267	36,661,867
Average unit cost (8% discounting)	12.71	2.95
NPC (3% discounting)	157,850,901	49,732,347
Average unit cost (3% discounting)	12.71	4.00
Total cost (no discounting)	157,866,388	62,808,930
Average unit cost (no discounting)	12.71	5.06
10-year evaluation		
NPC (10% discounting)	157,821,130	25,907,260
Average unit cost (10% discounting)	25.42	4.17
NPC (8% discounting)	157,822,493	27,161,420
Average unit cost (8% discounting)	25.42	4.37
NPC (3% discounting)	157,826,710	31,133,670
Average unit cost (3% discounting)	25.42	5.01
Total cost (no discounting)	157,833,268	34,278,752
Average unit cost (no discounting)	21.61	5.52

NPC = net present cost

4.1.1. Comparing large-scale rainwater harvesting and desalination

The two main options considered in this report as supplementary water sources for Bonriki are LSRH and desalination, both of which are designed to provide 1,700 kL/day, if required. The costs of these two options are shown in Table 10. Cost estimates support previous studies such as the TWMP (White 2010a) in concluding that desalination is the more cost-efficient option for large-scale water production. For example, as can be seen in Table 10, in the 50-year analysis, the cost of desalination

per unit ranges between AUD 1.2/kL (for a 10% discount rate) and AUD 5.2/kL (with no discounting) compared with the cost of LSRH, which ranges between AUD 5.5/kL and AUD 9.4/kL. Figure 6 demonstrates the difference in magnitude of the costs of desalination and rainwater.

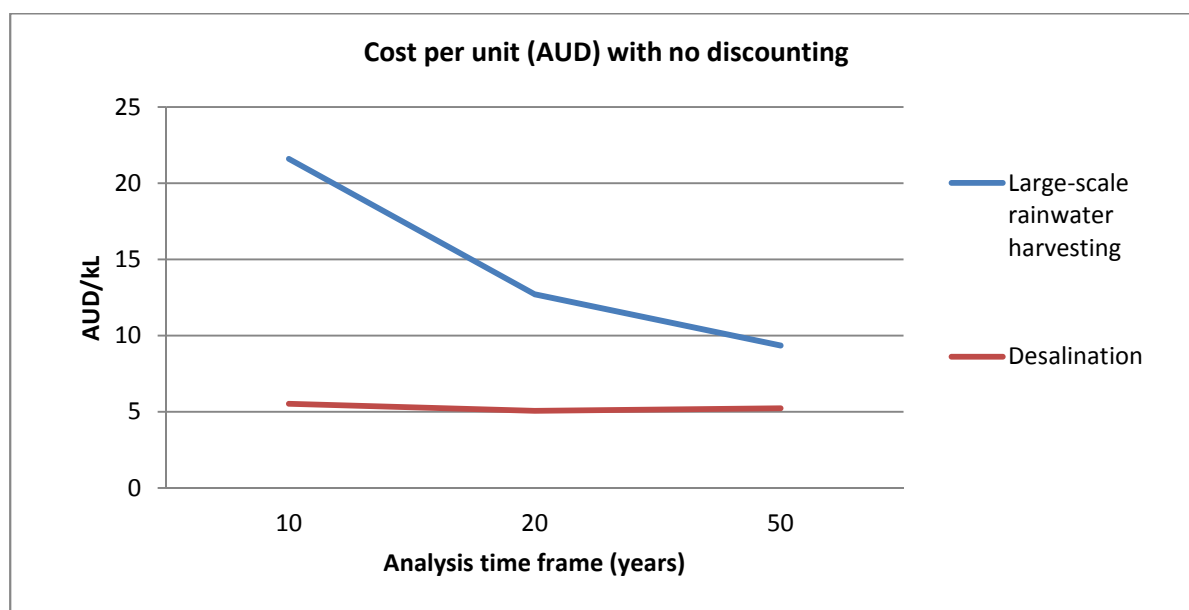


Figure 6: Comparison of large-scale rainwater harvesting to desalination.

Even if the large-scale rainwater harvesting roofing infrastructure was to last for 50 years before requiring replacement, the unit cost of rainwater is still almost twice that of desalination.

4.1.2. Including distribution costs in large-scale rainwater harvesting and desalination

This analysis focused on the cost of production of LSRH and desalination. Nevertheless, after production, the water would need to be distributed to households. Recent reports have estimated water losses via distribution at around 50% (Fraser Thomas Partners 2012; White 2010a). Once these losses and their consequent costs are included in the total cost of supplying water to households, unit costs increase.

Adding distribution costs to LSRH

If, following other reports (Fraser Thomas Partners 2012; White 2010a), a 50% water loss from distribution is assumed (in order to deliver 1 unit of water to the household, 2 units must be produced), then the minimum cost of producing and delivering LSRH water to households would be (AUD 9.35/kL X 2) = AUD 18.70/kL.

Adding distribution costs to desalination

If, following other reports (Fraser Thomas Partners 2012; White, 2010), a 50% water loss from distribution is assumed (in order to deliver 1 unit of water to the household, 2 units must be produced), then the minimum cost of producing and delivering desalinated water to households would be (AUD 5.06/kL X 2) = AUD 10.12/kL.

4.1.3. Putting the least cost option (desalination) into perspective

Desalination has been found to be the least costly option, but it is useful to ask how these large-scale options (LSRH and desalination) compare with other production options, such as smaller-scale private household rainwater harvesting and groundwater itself.

LSRH and desalination versus private (small-scale) household rainwater harvesting

Although no survey has been undertaken to record the current capacity for rainwater harvesting, which makes the estimation of harvesting potential difficult, White (2011b) has estimated that historically, the cost of household rainwater has been approximately AUD 8.2/kL. Although private rainwater harvesting could never produce the full volume required to backup the PUB water supply, the use of existing suitable buildings has been recommended by previous reports (GWP 2012; White 2011a) and as a source of supplementary water (able to produce around 5 L/person/day in households with suitable roofs). Because of these recommendations, the estimated cost of private rainwater (White 2011b) is compared with the least costly option (desalination) found in this analysis. One of the main cost savings that private household rainwater harvesting offers is that it does not have to be distributed; instead, it is collected at the location where it will be used. On the other hand, large-scale sources of water (groundwater, LSRH and desalination) must incur costs of distribution. As explained in the above section, once expected (50% loss) distribution costs are included in the cost of LSRH, unit costs becomes AUD 18.70/kL and once expected (50% loss) distribution costs are included in the cost of desalinated water, unit costs become AUD 10.12/kL. This actually makes the true cost of supplying desalinated water (and consequently LSRH) to households slightly more expensive than household rainwater harvesting. Nevertheless, household rainwater harvesting could not provide the 1,700 kL required to act as a full back-up to Bonriki supply. It can however provide a valuable source of additional water on a small scale to households with suitable roof areas.

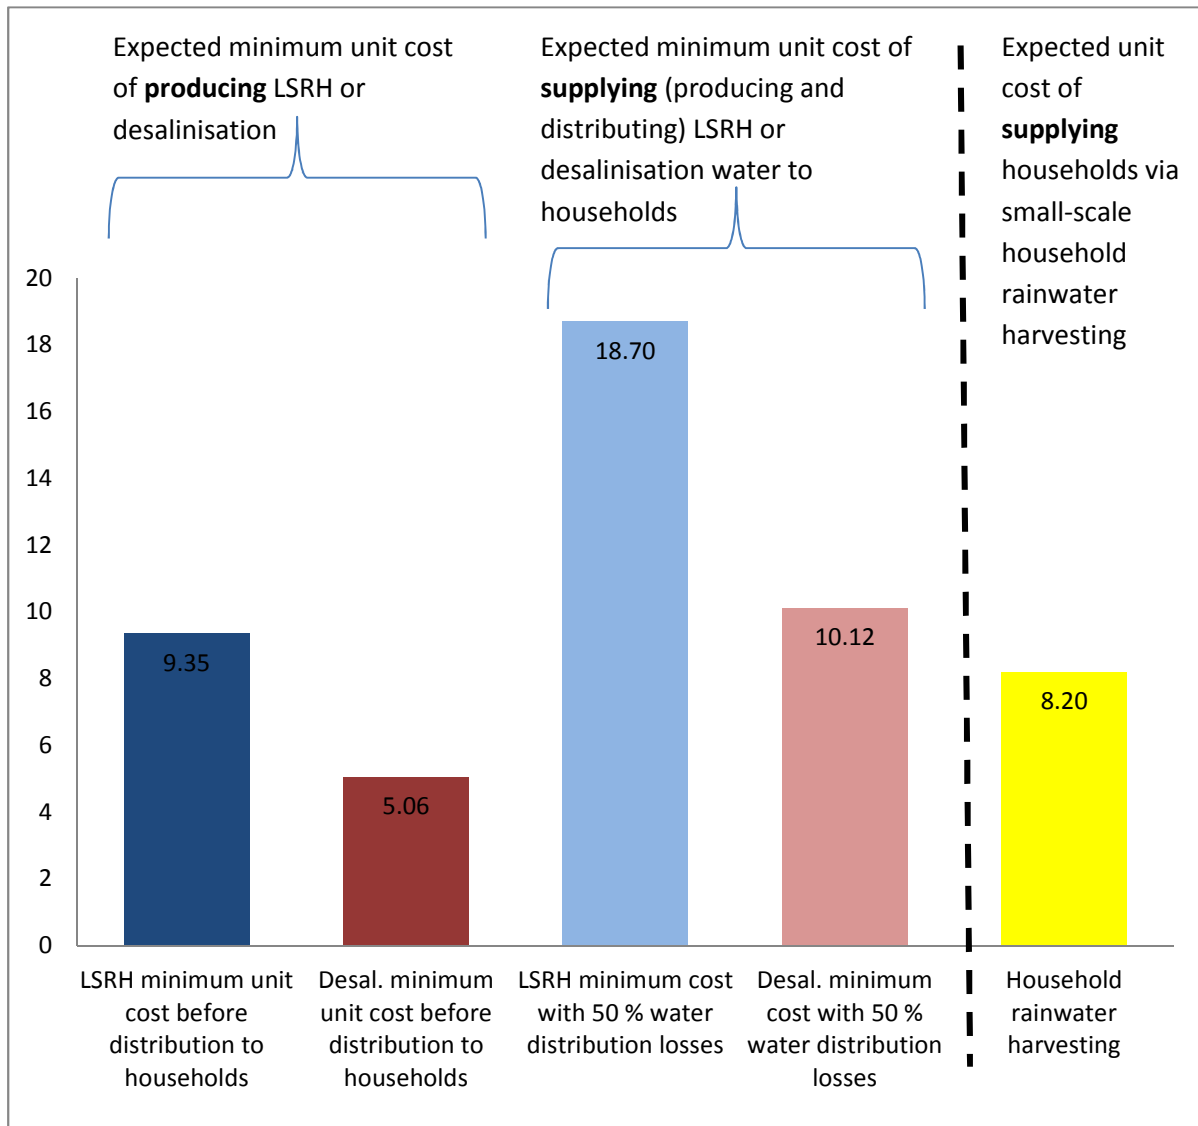


Figure 7: Comparing costs of large-scale rainwater harvesting and desalination supply (production and distribution costs) to cost of supply via household rainwater harvesting (AUD/kL, no discounting). LSRH = large-scale rainwater harvesting.

As shown in Figure 7, if the expected 50% loss through distribution are assumed (Fraser Thomas Partners 2012; White 2010), then the total cost of providing LSRH water to households via desalination (pale blue column) is over double the cost of household rainwater harvesting (yellow column). For desalination, if 50% losses through distribution are assumed, then the total cost of providing water to households via desalination (pale pink column) is also higher than that of household rainwater harvesting (yellow column).

These findings support a recommendation of incentivising household rainwater harvesting in order to produce supplementary water. Although household rainwater harvesting could not be relied on as a backup to groundwater or during extreme droughts, it is a relatively low-cost option for providing extra water in order to reduce stress on the PUB system during normal weather conditions.

One key difference between private rainwater harvesting and the PUB supplied water (Bonriki groundwater, LSRH and desalination), is that the production costs of private harvesting are usually incurred directly by households. This is briefly discussed in Section 6.

Groundwater versus LSRH and desalination

Although desalinated water is less costly than LSRH, it is still more costly than groundwater supplied from Bonriki and Buota. For example, as shown in Table 10, if Bonriki was not able to produce any water and desalination was required to produce the full 1,700 kL per day, the total cost over 10 years would be around 34 million AUD, this is likely to be far higher than the cost of producing via Bonriki. The estimated cost of groundwater (White 2010a) is AUD 3.60/kL, whereas the minimum expected cost for desalinated water is AUD 5.06/kL. In addition, desalination has far greater energy demands than groundwater abstraction and, given that energy is presently supplied via diesel combustion, desalination will produce more carbon emissions and increase Kiribati's trade balance deficit through higher diesel imports. Consequently, it is clear that groundwater is still Kiribati's least costly water source and that protecting groundwater reserves from human pressures such as encroachment (White 2010a) should be a key focus in the future.

4.2. (B) Least costly method of supplementation in illustrative scenarios

This section focuses on the two main water sources considered in this analysis — LSRH and desalination — as being able to produce the large volumes of water (1,700 kL/day) required to act as backups to the Bonriki supply.

Under each scenario, water produced from LSRH or desalination is only used at certain times of the year (i.e. the water they produce is only used when Bonriki's salinity is above 1,500 $\mu\text{S}/\text{cm}$). This makes the unit costs of production from rainwater and desalination higher because the installation costs and some of the running costs must still be incurred even if they are not required to produce water every day. Nevertheless, given that rainwater harvesting and desalination are being used as backups to ensure that the target freshwater volume and quality is reached, it is necessary to have them in place throughout the 50 years of the analysis so that they can be employed when needed. The NPC and unit costs (per kL) of production under each scenario are displayed in Table 11.

Table 11: Cost (in Australian dollars) of supplying water under different scenarios.

	scenario 1		scenario 2		scenario 3		scenario 4	
	LSRH	Desal.	LSRH	Desal.	LSRH	Desal.	LSRH	Desal.
50-year evaluation								
NPC (10% discounting)	169,135,884	12,941,409	169,135,884	33,159,029	169,135,884	13,963,524	169,135,884	33,159,029
Average unit cost (10% discounting)	85.62	6.55	6.79	1.33	53.94	4.45	6.79	1.33
NPC (8% discounting)	175,089,243	14,216,371	175,089,243	39,010,090	175,089,243	15,469,834	175,089,243	39,010,090
Average unit cost (8% discounting)	88.63	7.20	7.02	1.57	55.84	4.93	7.02	1.57
NPC (3% discounting)	214,818,803	22,795,226	214,818,803	73,984,954	214,818,803	25,383,158	214,818,803	73,984,954
Average unit cost (3% discounting)	108.75	11.54	8.62	2.97	68.51	8.10	8.62	2.97
Total cost (no discounting)	290,327,348	38,277,824	290,327,348	136,292,544	290,327,348	43,233,025	290,327,348	136,292,544
Average unit cost (no discounting)	146.97	19.38	11.65	5.47	92.59	13.79	11.65	5.47
20-year evaluation								
NPC (10% discounting)	157,831,165	11,430,856	157,831,165	28,669,226	157,831,165	12,302,353	157,831,165	28,669,226
Average unit cost (10% discounting)	199.75	14.47	15.83	2.88	125.84	9.81	15.83	2.88
NPC (8% discounting)	157,835,267	11,646,855	157,835,267	31,394,643	157,835,267	12,645,218	157,835,267	31,394,643
Average unit cost (8% discounting)	199.75	14.74	15.83	3.15	125.84	10.08	15.83	3.15
NPC (3% discounting)	157,850,901	12,478,498	157,850,901	41,888,082	157,850,901	13,965,319	157,850,901	41,888,082
Average unit cost (3% discounting)	199.77	15.79	15.83	4.20	125.85	11.13	15.83	4.20
Total cost (no discounting)	157,866,388	13,310,529	157,866,388	52,386,422	157,866,388	15,286,037	157,866,388	52,386,422
Average unit cost (no discounting)	199.79	16.85	15.83	5.25	125.86	12.19	15.83	5.25
10-year evaluation								
NPC (10% discounting)	157,821,130	10,962,565	157,821,130	22,760,467	157,821,130	11,559,016	157,821,130	22,760,467
Average unit cost (10% discounting)	399.47	27.75	31.66	4.57	251.66	18.43	31.66	4.57
NPC (8% discounting)	157,822,493	11,042,364	157,822,493	23,767,350	157,822,493	11,685,685	157,822,493	23,767,350
Average unit cost (8% discounting)	399.47	27.95	31.66	4.77	251.66	18.63	31.66	4.77
NPC (3% discounting)	157,826,710	11,295,109	157,826,710	26,956,413	157,826,710	12,086,877	157,826,710	26,956,413
Average unit cost (3% discounting)	399.48	28.59	31.66	5.41	251.67	19.27	31.66	5.41
Total cost (no discounting)	157,833,268	11,495,223	157,833,268	29,481,394	157,833,268	12,404,526	157,833,268	29,481,394
Average unit cost (no discounting)	339.57	29.10	26.91	5.91	213.93	19.78	26.91	5.91

4.2.1. Comparison of large-scale rainwater harvesting to desalination

As expected, Table 11 demonstrates that desalination, when compared with LSRH, is always the least costly way of producing larger volumes of water, which are required for South Tarawa, to supplement groundwater. This is due to: 1) the general cost of desalination being lower, as shown in part A of the results section; and 2) the fact that rainwater production costs (which mainly comprise upfront infrastructure costs) cannot be reduced during the times that water is not needed. On the other hand, in calculating desalination cost estimates it was assumed that variable costs of production (such as electricity) would be proportional to the volume produced. When less water is required, production can vary accordingly. Consequently, desalination production costs *can* be reduced if less water is required (i.e. plants can be turned off or run at lower capacity).

4.3. (C) Total costs in each scenario and comparison threats to Bonriki

As discussed in Section 3, by comparing the minimum costs of producing water in different scenarios it is possible to understand the likely effects of variables on production costs. Because desalination is less costly than LSRH, in each scenario costs would be minimised if the least costly large-scale option (desalination) is used to supplement Bonriki groundwater (the cheapest source available to Kiribati). The estimated cost of groundwater supplemented by desalination production is estimated for each scenario and displayed in Table 12. For ease of comparison the estimations use no discounting and are calculated for the 17-year time periods used in groundwater models.

Table 12: Scenario total cost comparisons.

Scenario	1	2	3	4
Proportion of time Bonriki salinity is above 1,500 $\mu\text{S}/\text{cm}$ (%)	6 %	80 %	10 %	80 %
Volume required from desalination (kL) over 17 years	671,500	8,472,800	1,065,900	8,472,800
Volume required from Bonriki (kL) over 17 years	9,882,100	2,080,800	9,487,700	2,080,800
Desalination unit cost over 17 years (AUD)	16.85	5.25	12.19	5.25
Bonriki unit cost over 17 years (AUD)	3.6	3.6	3.6	3.6
Total cost of producing desalinated water over 17 years (AUD)	11,311,672	44,519,494	12,990,516	44,519,494
Total cost of Bonriki abstraction ¹¹ over 17 years (AUD)	35,575,560	7,490,880	34,155,720	7,490,880
Total cost of producing 1,700 kL/day over 17 years (AUD)	46,887,232	52,010,374	47,146,236	52,010,374

¹¹ Assumed to be AUD 3.60/KL (White 2010a).

4.3.1. Total costs in each scenario

By looking at the total costs of producing 1,700 kL water per day in each scenario, it is clear that the more water required from desalination, the higher the total costs to the PUB. Costs increase with the number of days (proportion of time) that Bonriki salinity is above 1,500 $\mu\text{S}/\text{cm}$. Nevertheless, for desalination, the unit costs of production will *decrease* with the number of days Bonriki salinity is above 1,500 $\mu\text{S}/\text{cm}$. This is because in these cases, the total number of units produced by desalination increases and the fixed implementation costs (e.g. constructing desalination plants) are divided over more units of production. In other words, the more the desalination plants are used (such as in scenarios 2 and 4), the lower the *unit* costs of production will be, but, the total cost of production will, of course, always increase with the number of units produced. In economic terms, the marginal cost schedule of desalination production decreases until plants are producing at their maximum capacity.

4.3.2. The cost of seawater inundation during high rainfall period

The effect of a seawater inundation during a high rainfall period can be estimated by calculating the cost of scenario 3 over the 17-year period minus cost of scenario 1 over the 17-year period. During wet periods, seawater inundation would increase the proportion of time that Bonriki salinity is above the threshold and the number of days that alternative sources must be used. The total cost of seawater inundation during high rainfall times is estimated at approximately AUD 260,000 the 17 years of simulation.

4.3.3. The cost of seawater inundation during low rainfall period

The effect of a seawater inundation during a low rainfall period can be estimated by calculating the cost of scenario 4 over the 17-year period minus cost of scenario 2 over the 17-year period. Surprisingly, the total cost of seawater inundation during low rainfall times is estimated to be zero over the 17 years of simulation. This is because the effect of rainfall is so much larger than the effect of seawater inundations on Bonriki salinity that the simulations predict that during dry conditions there would be no difference in the number of days that Bonriki salinity is above the 1,500 $\mu\text{S}/\text{cm}$ threshold with or without a seawater inundation.

4.3.4. The cost of reduced rainfall

The effect of having a low rainfall period rather than a high rainfall period can be estimated by comparing the cost of scenario 2 over the 17-year period minus cost of scenario 1 over the 17-year period. The total cost of a period of low rainfall compared with a period of high rainfall in this model is estimated at approximately AUD 5 million for the 17 years of simulation.

4.3.5. Summary of results from scenario comparisons

Having compared the costs of producing 1,700 kL of water per day under different scenarios it is possible to infer that:

- supply costs increase with the number of days (proportion of time) that Bonriki salinity is above 1,500 $\mu\text{S}/\text{cm}$;

- the effect of having a period of low rainfall versus a period of high rainfall is more costly than extreme seawater inundation;
- the costs of experiencing a low rainfall period relative to high rainfall period are approximately 20 times greater than the cost of extreme seawater inundation during a wet period (estimated at approximately AUD 260,000); and
- during low rainfall periods, simulations suggest that the cost of extreme seawater inundation would be completely obscured by the far greater cost of a low rainfall period.

4.4. Sensitivity analysis

In this section, the assumptions and uncertainties of the analysis are discussed in order to check the level of robustness of the results.

4.4.1. Desalination

Cost assumptions

From the Fraser Thomas Partners (2012) cost break-down, it is not possible to tell whether ongoing costs are in real or nominal terms. Because the analysis they conducted was termed an 'economic analysis' it is assumed that these are real costs (at 2012 prices). If this is not the case, then the cost estimations in this analysis will have slightly overestimated the cost of desalination water production. Nevertheless, this would not change the ranking of desalination as the least costly method of supplementing groundwater.

The peer review (Harrison Grierson Consultants 2013) made some valid comments on the robustness of the Fraser and Thomas financial analysis. Aside from the cost of disposing and recycling the plants after their 30-year lifespan comes to an end (which has already been accounted for in the main calculations and results discussed in Section 4 of this report), the peer review also noted some other factors that may impact the cost of desalinated water production.

- Significant cost savings associated with using fewer, larger plants at a central site.
- Concern about cost of importing plants in 40-foot containers when the current port capacity is 20-foot containers. To account for this, port handling fees were increased by 70% in Harrison Grierson Consultants (2013), and even with this increase the review concluded that there would be significant cost savings associated with using fewer, larger plants at a central site.
- Risks associated with leaving day-to-day operations of the plants to the PUB were highlighted in the peer review. It was suggested that the supply of items requiring constant replacement and the preparation of the 'multimedia and calcite beds' should be provided by the contracted maintenance. Nevertheless, it was noted that this would likely only increase running costs marginally while providing benefits of reduced risks to the water supply operations from fluctuations government budgets.

Overall, once the three comments above are taken into account, there is likely to be a reduction in costs relative to those in the results section if fewer larger desalination plants were used as detailed in Harrison Grierson Consultants (2013). This lends further support to the cost-effectiveness of

pursuing desalination rather than purpose-built, large-scale rainwater catchment structures when large volumes of production are required.

Historical desalination estimates

Desalination costs were also estimated using data from Metutera (2002). The unit costs were significantly higher than those estimated in the main estimates as shown in Table 13. All costs are in AUD. The Metutera (2002)-based cost estimates are higher because aside from the inefficiency of using multiple small units for large-scale production, these older plants require more frequent replacement given their six-year life expectancy. Nevertheless, these second, higher desalination costs were still lower than those of using large-scale rainwater harvesting, confirming that desalination is likely to be less costly than LSRH as a method of supplementing groundwater.

Table 13: Comparison of main desalination cost estimates with those based on Metutera (2002).

	Desalination (main estimate)	Desalination (Metutera 2002)
50-year evaluation		
Total cost (no discounting)	162,435,498	276,605,654
Average unit cost (no discounting)	5.23	8.91
20-year evaluation		
Total cost (no discounting)	62,808,930	113,100,915
Average unit cost (no discounting)	5.06	9.11
10-year evaluation		
Total cost (no discounting)	34,278,752	56,550,457
Average unit cost (no discounting)	5.52	9.11

Fuel price

Given the predictions of OPEC (2013), this analysis has assumed a constant real price of fuel. Nevertheless, fuel price predictions are susceptible to high degrees of error, and changes in fuel price would translate into changes in desalination production costs. Nevertheless, an increase of fuel costs of around 500% would be required to make desalination as costly as LSRH, which is considered unlikely. Any decrease in fuel costs would make desalination even more cost efficient compared with LSRH. Additionally, if energy was to be supplied via an alternate technology, such as solar power, and the energy could be produced more cheaply than by fossil fuel combustion, then the cost of desalination would also decrease.

Environmental aspects

As suggested in Harrison Grierson Consultants (2013), before finalising the design of desalination operations, experts should evaluate:

- the sustainable volume that may be abstracted from the saltwater boreholes to mitigate over abstraction;
- any impact on coastal processes that may occur from the use of infiltration galleries (the movement of sediment etc.); and any effect that the brine discharge may have on biodiversity and marine life.

Approximately 42% of the seawater volume processed by the desalination plants is emitted as freshwater for use by the population; the remaining 58% will be returned to the ocean in the form of a brine solution that includes the backwash water. Not only will the brine have an increased salt content, it could also contain chemicals used in the treatment process such as anti-scalant and sodium meta-bisulphite. The TWMP (White 2010a) highlights the fact that the brine solution should be discharged into the ocean during outgoing tides to reduce the probability of brine coming into contact with the shoreline.

The possibility of environmental costs of desalination should be considered if this option is to be pursued; in particular, to the surrounding marine life (on which much of the population depends) and the planned disposal of membrane modules into local landfills. An environmental impact assessment would need to be undertaken in order to determine any environmental implications so that these could be added to the costs of using desalinated water supplies in a full economic analysis. It is expected that the environmental impact assessment would need to be undertaken externally.

It is challenging to quantify environmental factors but any environmental effects caused by desalination would increase costs. If the environmental effects were expected to be significant, then the design of this option would need to be modified in order to reduce the impact on the environment to a negligible level.

4.4.2. Rainwater

Cost assumptions

In the analysis, the maximum life expectancy of the roof infrastructure (50 years) is assumed. Likewise, the minimum cost of installation of harvesting infrastructure is assumed. A shorter life expectancy or higher installation costs would make LSRH an even more expensive option relative to desalination. Additionally, any rental payments to landowners which may be required were also excluded from the analysis and would increase the cost of LSRH compared with desalination. Consequently, none of these elements would affect the ranking of desalination as less costly than LSRH.

Capture rate

The reports on which the rainwater infrastructure and catchment data for this analysis is based use the assumptions from the White and FalkLand (2009) water model. A key variable in this model is the runoff coefficient which is set at 0.85. Kinrade et al. (2014), when estimating the volume of rainwater harvesting potential in Tuvalu, used a run-off coefficient of 0.65 to 0.72 in the first year of analysis which was then decreased over time to reflect the poor quality of maintenance. As it is so vital that maintenance be carried out, this analysis has included the cost of employing a dedicated maintenance officer in order to allow the coefficient to remain at 0.85 throughout the life of the harvesting infrastructure. Previous analysis (GWP Consultants 2010; Kinrade et al. 2014) have suggested that a lack of maintenance is one of the main reasons for low capture rates. In the case that maintenance was for some reason not carried out, the run-off coefficient in this analysis would decrease and the cost of rainwater would increase. The cost of LSRH (already the most expensive option) would increase even further.

Environmental aspects

Rainwater harvesting is unlikely to have a negative impact on the environment although if rainwater run-off was previously feeding into a groundwater lens then it may be possible that the lens volume would be reduced. If large-scale rainwater harvesting was to be pursued then an analysis of any risks to groundwater in the area would need to be undertaken.

4.4.3. General assumptions

Changes in the water production target

The 1,700 kL target was chosen because it is expected to be on the order of magnitude of current groundwater abstracted from Bonriki by the PUB. Abstraction rates have been known to vary over time, and if the target water volume was to change, then total production costs also would change. Nevertheless, unless there is a dramatic change in the target volume, unit production costs can be expected to remain similar. Consequently, small changes in the production target are not expected to change the cost-effectiveness ranking of desalination compared with LSRH or any of the key results of this analysis.

Discount rate

As shown in Table 10, whichever discount rate is used, desalination is always less costly than LSRH.

5. Key findings and management implications

5.1. Key findings

5.1.1. Least-cost option suitable to backup Bonriki supply: Reverse osmosis desalination

As shown in Table 10, producing water via desalination is much more cost efficient than LSRH. Unit production cost ranges between AUD 5.1/kL and AUD 5.5/kL, depending on the time frame of the analysis compared with the cost of LSRH, which ranges between AUD 9.4/kL and AUD 21.6/kL. This finding remains the same, regardless of the discount rate, large changes in fuel prices, increased costs from outsourcing parts of the desalination production and maintenance process to external contractors and changes in the abstraction rates. Nevertheless, if future research finds that environmental impacts are significant, then desalination may become a less cost-efficient option.

5.1.2. Groundwater remains the least costly source of water

Although desalinated water is less costly than LSRH it is still more costly than groundwater supplied from Bonriki and Buota. The estimated cost of groundwater (White 2010a) is AUD 3.60/kL, whereas the minimum expected cost for desalinated water is AUD 5.06/kL. In addition, desalination has far greater energy demands than groundwater abstraction and, given that energy is presently supplied via diesel combustion, desalination will produce more carbon emissions and increase Kiribati's trade balance deficit through higher diesel imports.

It is also informative to compare the cost of desalination to other sources such as small-scale rainwater harvesting. Once water distribution costs are added to the cost of producing desalinated water, the total cost of supplying desalinated water to households may prove more costly than supplying water via small-scale household rainwater harvesting. Although small-scale household rainwater harvesting could never produce the large volumes of water required by desalination to supplement the Bonriki supply, it could be a valuable source of additional water for households, independent of the PUB.

5.1.3. Scenario analysis

Having compared the costs of producing 1,700 kL of water per day under different scenarios it is possible to infer that:

- supply costs increase with the number of days (proportion of time) that Bonriki salinity is above 1,500 $\mu\text{S}/\text{cm}$ and supplementary sources are required;
- the effect of having a period of low rainfall versus a period of high rainfall is more costly than extreme seawater inundation;
- the costs of experiencing low rainfall period relative to high rainfall period are approximately 20 times higher than the cost of extreme seawater inundation during a wet period, and infinitely more costly than the cost of extreme seawater inundation during a dry period; and
- only during high rainfall periods is the effect of a seawater inundation on production costs likely to be felt.

5.2. Implications for future management

5.2.1. Focus on protection of groundwater supply

This analysis supports previous studies such as the TWMP (White 2010a) in concluding that desalination is the more cost-efficient option for large-scale water production to supplement groundwater. Nevertheless, groundwater supplied from Bonriki and Buota remains the least costly source of water. The estimated cost of groundwater (White 2010) is AUD 3.60/kL, whereas the minimum expected cost for desalinated water is AUD 5.06/kL. In addition, desalination has far greater energy demands than groundwater abstraction, will produce more carbon emissions and increase Kiribati's trade balance deficit through higher diesel imports. Consequently, it is clear that groundwater is still Kiribati's least costly water source.

The scenario simulations and estimated costs of water production under different conditions produce two main results:

- supply costs increase with the number of days (proportion of time) that Bonriki salinity is above 1,500 $\mu\text{S}/\text{cm}$ and supplementary sources are required, and
- the effect of having a period of low rainfall versus a period of high rainfall is more costly than an extreme seawater inundation.

These results indicate that even extreme inundation is only expected to cost between zero and AUD 260,000 over the 17-year simulation, which is far below the expected cost of a period of dry weather (approximately AUD 5 million over the 17-year simulation). Because policy-makers cannot change

the rainfall, and that protecting groundwater from extreme inundation events is likely to cost more than the resulting benefits (reduced inundation costs), it is recommended that the focus instead be on more feasible approaches to reducing the cost of supplying PUB water, such as maintaining the salinity of Bonriki to an acceptable level through continued sustainable abstraction, protecting groundwater reserves from human pressures such as encroachment (White 2010a), and reducing leakage from water distribution pipes (Fraser Thomas Partners 2012; White 2010).

5.2.2. Merit of small-scale water supplementation

As discussed in the results section, if the normal 50% losses through distribution are assumed (Fraser Thomas Partners 2012; White 2010), then the total cost of providing water to households via desalination is higher than that of small-scale household rainwater harvesting. This supports a recommendation of incentivising household rainwater harvesting in order to produce supplementary water. Nevertheless, household rainwater harvesting could not be relied on as a backup to groundwater or during extreme droughts due to the insufficient area of existing roof catchments available for connection and susceptibility to drought conditions. It is simply a relatively low-cost option for providing small volumes of extra water in order to reduce the stress on the PUB system during normal weather conditions.

Although private household systems can only supplement water requirements (producing around 5 L/person/day for household members), any increase in water supply should be considered by the government. Even if it is not a 'silver bullet' answer to South Tarawa's water scarcity challenge, every bit of extra water that can be viably produced at low cost will help in improving the standard of living and reduce pressure on the PUB water supply and ultimately the Bonriki water resource.

5.2.3. Wider perspective on challenges

This analysis focused on the most cost-effective way of ensuring that the government can produce the target water volume (1,700 kL/day) over the next 50 years, taking into consideration the threat of a seawater inundation. Nevertheless, it is necessary to put this objective in perspective. Even if it is assumed that: 1) the PUB distribution system is renovated — reducing water loss to 25%; 2) there will be zero net inward migration to Tarawa; and 3) the current 1,700 kL of water can continue to be supplied each day, within 20 years this would no longer be sufficient to provide the Sphere Standard Basic 15 L/person/day in South Tarawa.

For this reason, in order to ensure that the government can provide a minimum volume of water to the population, it must also focus on protecting existing water resources. A policy of just increasing water supply via human-made freshwater (i.e. desalination) in line with population could simply increase incentive for inward migration to South Tarawa and add to social costs through further strain on sanitation infrastructure, food and land resources.

Water conservation and resource protection requires behavioural changes. Unfortunately, these are complex and slow to change, sometimes taking many years for behavioural change initiatives to take effect. This, among the many other challenges associated with behavioural changes often forces it to the bottom of the list of priorities for policy-makers who are likely to be confronted with the short-

term costs and challenges but who will not be around to see the long-term benefits. This also reduces the incentive of short-term initiatives (two to five years) to use funds for water management projects versus quick fix infrastructure projects. Nevertheless, as project evaluation and accountability become more important and the focus turns to longer-term outcomes and sustainability, these other root-causes of scarcity will need to be tackled alongside supply initiatives.

6. Enabling environment and future work required

6.1. Financing: Who pays?

Both of the large-scale supplementation options considered in the main analysis (LSRH and desalination) were designed to be the responsibility of the government PUB, just as Bonriki groundwater currently is. The LSRH would use purpose-built, government-constructed roof catchments, and desalination would also be controlled by the PUB. Nevertheless, due to large production costs, it is likely that whichever of the water production options is implemented, the government will be unable to cover all financial costs. Consequently, the government would need to rely on external assistance in order to progress these options.

6.2. Environmental assessments

As suggested in Harrison Grierson Consultants (2013), before finalising the design of desalination operations, experts should evaluate:

- the sustainable volume that may be abstracted from the saltwater boreholes to mitigate over abstraction;
- any impact on the coastal processes that may occur from the use of infiltration galleries (the movement of sediment etc.); and any effect that the brine discharge may have on biodiversity and marine life.

Once the above information is known, an environmental impact assessment would need to be undertaken and the cost of any environmental implications would need to be added to the desalination production costs in a full economic analysis. It is expected that the environmental impact assessment would need to be undertaken externally.

6.3. Operating desalination plants

The day-to-day operation of the plants would be conducted by the PUB, and would include managing the chemical inputs and changing certain filters (as detailed in Harrison Grierson Consultants 2013). In order to ensure the smooth operation of the plants it is recommended that technicians be trained by desalination unit suppliers. In addition, to avoid the loss of these skills from the country it may be necessary to tie the training scholarships to contracts with the PUB, which would require the newly trained engineers to work for a certain number of years for the PUB and to pass on their skills to other elected staff through formal training sessions. Not only will this ensure that local capacity is increased, it will also reduce the risk of skills being lost over time as workers move on. If desalination suppliers are not confident that the PUB has sufficient capacity to operate

the plants, it would be necessary to factor in the cost of contracting full-time technicians from elsewhere.

6.4. Distribution of water

The objective of this analysis was to estimate the costs of producing water via desalination or LSRH in order to supplement Bonriki groundwater. Nevertheless, the water supplied through the options assessed would still need to be distributed to consumers. The current PUB distribution system is likely to be the least costly and disruptive system but it is recommended that renovations take place beforehand (Fraser Thomas Partners 2012; White 2010a).

The PUB distribution system pumps groundwater from Bonriki and Buota to the population. Although in 2013 the average groundwater abstraction from these lenses was 1,960 kL/day, a large proportion of this water is reported to be 'lost' due to pipe system leakage. Metutera (2002) and the PUB conducted a village survey in Nanikaai village, South Tarawa and found that from just one of the many connection points on the distribution system alone (the household tap connection to the pipes), around 25–40% of the water supply was being lost. The more recent TWMP reported at least 50% loss due to leakage from the piping system (White 2010a). The 2012 economic analysis of desalination (Fraser Thomas Partners 2012) suggested that 67% of the water is lost. Although some of the water 'lost' is, in reality, still reaching users through illegal connections to the piping system, there is no information on what percentage of this 'lost' water is used.

Given the existing water constraints that Tarawa currently faces, and the high existing water losses from the distribution system, it is of vital importance to renovate the existing distribution system before the government proceeds with other interventions. Without improvements, the losses will continue to increase the cost of water produced and distributed. Without renovations, the cost of water produced by desalination that has been estimated in this report would need to be doubled to account for these large (approximately 50%) losses in order to represent full costs to the government in supplying water to consumers.

A recent report by Fraser Thomas Partners (2012) has estimated the cost of renovating the existing system in order to reduce leakage to 25% to around AUD 5 million. Based on this figure it is possible to calculate the approximate recuperation period here. If costs were indeed AUD 5 million, maintenance per year was 5% of this, and the volume of water distributed via the system was 1960 kL, then benefits would outweigh the costs of renovation within 50 years, even if an 8% discount rate is used (benefit to cost ratio = 1.06). If more water was to be distributed through the system or if discount rates were reduced then the benefits would outweigh costs in less time. Harrison Grierson Consultants Limited (2013) noted that the time scale suggested in Fraser Thomas Partners (2012) is likely to be overly optimistic, and renovations could take more time and consequently cost more. If renovation costs were 50% more (AUD 7.5 million), maintenance was 5% of this, and an 8% discount rate is used, around 3,000 kL would need to be distributed through the system per day in order for benefits to outweigh costs over 50 years.

6.5. Groundwater supply sustainability, protection and community ownership

The renovations discussed above (which include meter installation) would also allow the government to pursue demand management and cost recovery mechanisms if it chooses to. At present, those with water pipe connections have no financial incentive to limit water wastage (a flat connection fee of AUD 15 is paid per month by households) and those who cannot afford this fee must use another household's water, rainwater or resort to unsafe household wells. If the government wishes to sustainably provide water for its population in the future it must consider pursuing a mechanism to incentivise more water conservation. Upgrading the PUB distribution system and installing meters will be a prerequisite for this.

Sustainability of groundwater supplies in terms of community ownership and acceptance is also important. Community discussions and participatory approaches allow communities to generate their own solutions to problems, increasing community participation and the long-term success of initiatives, but in some cases this type of discussion is made difficult for the government. The traditional values held by families regarding land and groundwater as private family property makes government involvement in water supply, especially through groundwater, a controversial issue. Many families believe compensation should be paid for the use of their land and groundwater, hampering the protection of natural reserves and the government's ability to restrict settlement on reserve land. Regardless of which party holds the property rights, it will be possible to reach a given level of conservation and reduction in settlement provided enough compensation is paid. The more rights that are held by the government, the less compensation they would be required to pay.

6.6. Responsible water management

Part of minimising the cost to the PUB in providing the (presently subsidised) water to consumers is to incentivise responsible management at the household level.

Education and public awareness: In order to further aid the government in addressing water supply pressures it is recommended that action be taken to alert the population to the risks faced and the importance of responsible water use and of the merits of capturing household rainwater. Practices such as only using valuable, safe water for drinking, basic hygiene practices and basic cooking needs could be enforced. Schools and church groups could be used as channels through which to promote good water management.

Education can also be used to improve health and sanitation. Teaching the benefits of safe water sourcing, treating water before consumption, and maintaining water tanks to reduce contamination are likely to have large long-term benefits through decreased health costs. The recent Asian Development Bank report on the costs of poor water and sanitation practices in South Tarawa highlight the gains that could be made in this area (ADB 2014). If the public is informed of the high quality of rainwater relative to other supplies, their perceptions of rainwater versus groundwater may also change. Although education and awareness initiatives are costly in the short term and the benefits likely to be reaped in future years, the government will be compelled to address demand management going forward if a sustainable equilibrium is to be met.

Drought alerts: In times of drought, alerts can be provided via private rainwater tank levels as well as through government disseminated alerts. Private conservation alerts could be introduced when rainwater infrastructure is installed. For example, if government water authorities draw a 'red line' level on household tanks to indicate the number of days water supply left given the household size and daily demand, households will be able to check their water stock. When the water level passes below the 'red alert line', the household would be prompted to go into a stricter water conservation mode.

Reinstating traditional water values: As discussed in White (2007), water has always been valued highly at the family level (Talu et al. 1979). Consequently, it has been suggested that the recent government policy of supplying water through the PUB has removed the responsibility from households that would previously have identified careful use of water. Although by law households are supposed to pay for water from the PUB, many pipes have been reported to be tampered with and it is highly conceivable that water is siphoned off without any payments being made to the PUB. In addition, those that do make payments for water to the PUB actually have an *increased* incentive to use water, as they are making fixed sum payments that do not increase with their water use. Unfortunately, now that responsibility for water management has been transferred to the government, it is difficult to reinstate water conservation practices without financial-based interventions (such as reducing subsidies on PUB water). Why would household A employ extra time and energy using water more responsibly if household B next door (who is benefiting from household A's efforts via increased water security) does not bother to do the same? In order to reinstate traditional household values of responsible water use, policies must be undertaken by the government.

6.7. Incentivising small-scale rainwater harvesting and maintenance

An additional finding of this analysis supports the recommendation put forward by others (e.g. White 2010a) that any suitable buildings for rainwater harvesting should be employed in order to supplement water supply. At present, many suitable buildings are left without any harvesting capacity, which is a waste of existing roof infrastructure. It is likely that this waste of assets is due to the fact that unlike government-supplied water, these infrastructure costs would be incurred by inhabitants rather than the government. Usually, in order to incentivise agents to uptake a new policy (i.e. an increase in private production of water), the government could either compensate owners for implementing rainwater harvesting infrastructure or have them incur penalties if they do not. The first is likely to be too costly given the scarce government resources, the second (current policy) may fail due to the high costs of monitoring and enforcing regulation. The Ministry of Public Works and Utilities Water Engineering Unit is responsible for ensuring that new buildings are constructed with rainwater harvesting capabilities. Given the reports of many new buildings being constructed without any harvesting capacity (GWP Consultants 2010; White 2010a), it is suggested that the ministry looks at alternative solutions. If these direct methods of incentivising increased private production of water cannot achieve the expected results, a less direct method would be to simply charge all households and entities for the amount of PUB water they consume, thereby increasing the value of publicly supplied sources to households. All agents that can save enough on their PUB water bills by implementing rainwater harvesting will do so. As the cost of PUB water

increases, more agents will use rainwater harvesting. In addition, reducing subsidies for PUB water will increase water conservation within the household.

Government-assisted purchases: Recently households have been offered loans by the government to assist them in setting up private rainwater harvesting infrastructure. Aside from the increased affordability to the government, this scheme seems preferable to directly subsidising development because buyers still appreciate the full value of the equipment. Unless households contribute to the implementation of the infrastructure and its cost, it is unlikely that full care and maintenance of the resource will be taken. Proper maintenance is of vital importance to the functioning of the systems. Without it, the reliability and cost effectiveness of rainwater decreases. This form of self provision of the infrastructure, with help from the government if required, is likely to be the optimal method of ensuring the infrastructure is cared for. White (2010b) also notes that community level competitions and prizes can motivate better maintenance.

6.8. Replicability

Findings indicate that desalination would be more cost effective than LSRH under Tarawa's rainfall conditions. The high variation in rainfall requires large capture areas and tank storage capacity to be employed in order to ensure that the water supply does not fail during droughts. This finding is likely to apply to other locations which experience high volatility in the annual rainfall and have limited groundwater capacity to rely on. The importance of rainwater harvesting maintenance, which was discussed in this report, has already been highlighted in previous studies for Tarawa (GWP Consultants 2010; White 2010) and a gutter maintenance programme has also been recommended as the basis for future water security in Tuvalu (Kinrade et al. 2014).

References

ADB (Asian Development Bank). 2014. Economic costs of inadequate water and sanitation: South Tarawa, Kiribati. Asian Development Bank, Mandaluyong City, Philippines.

Bosserelle A., Jakovovic D., Post V. Galvis Rodriguez S., Werner A. and Sinclair P. 2015. Assessment of sea level rise and inundation effects on the Bonriki freshwater lens, Tarawa, Kiribati: Groundwater modelling report. Report for Bonriki Inundation Vulnerability Assessment Project. Flinders University, Adelaide, School of Environment, and Geoscience Division, Secretariat of the Pacific Community. SPC Technical Report SPC00011.

CSIRO (Commonwealth Scientific and Industrial Research Organisation). 2011. Climate change in the Pacific: Scientific assessment and new research. Volume 2. Accessed November 2014 at: www.pacificclimatechangescience.org/.../Volume-2-country-reports.pdf

Damlamian H., Bosserelle C., Kruger J., Raj A., Begg Z., Kumar S., Lowe R., Buckley M., Baleilevuka A. 2015. Bonriki Inundation Vulnerability Assessment: Inundation Modelling of Bonriki Islet, Tarawa, Kiribati. SPC Technical Report SPC00007.

Fraser Thomas Partners. 2012. South Tarawa water supply options assessment desalination feasibility study. South Tarawa Sanitation Improvement Project TA-7359(KIR). Produced for the Government of Kiribati and the Asian Development Bank.

Gerber F., Holland P. and Lal P.N. 2011. Assessing the social and economic value of climate change adaptation in the Pacific region — A case study on water quality, quantity and sanitation improvements as an adaptation to climate change, Tuvalu. A background case study for IUCN's report, Climate Change Adaptation in the Pacific: Making Informed Choices, prepared for the Australian Department of Climate Change and Energy Efficiency (DCCEE). International Union for Conservation of Nature, Suva, Fiji.

GWP Consultants LLP. 2010. South Tarawa rainwater harvesting assessment for the Government of Kiribati. Report No. 101104.

Harrison Grierson Consultants Limited. 2013. TA-7359-KIR South Tarawa water supply desalination feasibility study peer review report. Produced for the Pacific Infrastructure Advisory Center. HG Document No. R001v9-AK133440-01.

Kinrade P., Arold N., Pickering P., Rook, E. and Manfredo J. 2014. Pacific adaptation (costs and benefits) scenarios: Water security in Tuvalu. Technical Report.

KNSO (Kiribati National Statistics Office) and SPC (Secretariat of the Pacific Community). 2012. Kiribati 2010 census — Volume 2. Secretariat of the Pacific Community. Nouméa, New Caledonia.

Metutera T. 2002. Water management in Kiribati with special emphasis on groundwater development using infiltration galleries. Case study presented as part of Theme 1, Water Resources

Management, at the Pacific Regional Consultation Meeting on Water in Small Island Countries, Sigatoka, Fiji, 29 July– 3 August 2002.

KNSO (Kiribati National Statistics Office). 2010. Report on the Kiribati 2010 census of population and housing – Volume 1: Basic information and tables. Republic of Kiribati, August 2010.

National Statistics Office. 2005. 2005 Census of Population. Volume 1. Bairiki, Republic of Kiribati

National Statistics Office and SPC. 2010. Kiribati 2010 Census. Volume 2. Bairiki, Republic of Kiribati

One World Nations Online. 2015. Google Earth Kiribati Map. accessed March 2015 at
http://www.nationsonline.org/oneworld/map/google_map_Tarawa.htm

OPEC (Organization of the Petroleum Exporting Countries). 2013. World Oil Outlook 2013. Accessed online October 2014 at:
http://www.opec.org/opec_web/static_files_project/media/downloads/publications/

Pacific Institute. 2006. Desalination with a grain of salt — A California perspective. Pacific Institute for Studies in Development, Environment, and Security. OakLand, California.

PACCSAP (Pacific–Australia Climate Change Science and Adaptation Planning). 2014. Climate variability, extremes and change in the western tropical Pacific: New science and updated country reports. Accessed online: January 2015 at
<http://www.pacificclimatechangescience.org/publications/reports/climate-variability-extremes-and-change-in-the-western-tropical-pacific-2014/>

Parris A. 2012. Global sea level rise scenarios for the United States National Climate Assessment. NOAA Technical Report OAR CPO-1. Climate Program Office, Silver Spring, MD. Available at:
http://cpo.noaa.gov/sites/cpo/Reports/2012/NOAA_SLR_r3.pdf

PDalo. 2014. Pacific damage and loss information system. Accessed online October 2014 at:
<http://www.desinventar.net/DesInventar/results.jsp>

Republic of Kiribati. 2007. Republic of Kiribati National Adaptation Program of Action (NAPA) 2007. Environment and Conservation Division, Ministry of Environment, Land, and Agricultural Development, Government of Kiribati. Tarawa, January 2007.

Republic of Kiribati. 2012. Island Report Series. Volume 6: South Tarawa. Office of Te Beretitenti, South Tarawa.

Rios Wilks A. 2015. Economic analysis of water management options for impacts from inundation, climate variability and high abstraction rates, Bonriki water reserve, South Tarawa, Kiribati. Secretariat of the Pacific Community Pacific–Australia Climate Change Science and Adaptation Planning, Bonriki Inundation Vulnerability Assessment. SPC Technical Report SPC00011.

Talu A., Baraniko M., Bate K., Beiabure M., Etekiera K., Fakaodo U., Itaia M., Karaiti B., Kirion M.T., Mamara B., Onorio A., Scutz B., Taam T., Tabokia N., Takaio A., Tatura A., Teanako B., Tenten R.,

Tekonnang F., Teraku T., Tewe T., Tiata T., Timiti U., Kaiuea T. and Uriam K. 1979. Kiribati: Aspects of history. Fiji Times and Herald Ltd., Suva, Fiji. 212 p.

The Sphere Project. 2014. The Sphere Handbook. Accessed online Aug 2014 at <http://www.spherehandbook.org/en/water-supply-standard-1-access-and-water-quantity/>

Werner A.D., Galvis Rodriguez S., Post V. E.A. and Jakovovic D. 2015. Atoll island hydrogeology and vulnerability to seawater intrusion - a literature review. eport for Bonriki Inundation Vulnerability Assessment Project. Geoscience Division Technical Report. Secretariat of the Pacific Community.

White I. 1996. Fresh groundwater lens recharge, Bonriki, Kiribati. Preliminary report. International Hydrological Programme. UNESCO, Paris. Accessed online Feb 2015 at: <http://unesdoc.unesco.org/images/0010/001060/106002E.pdf>

White I. 2007. A whole of government approach to water policy and planning. Pacific Program for Water Governance, Republic of Kiribati Pilot Project. Australian National University.

White I. 2010a. Tarawa Water Master Plan 2010–2030. Coordinated by the National Adaptation Steering Committee under Office Te Beretitenti and the National Water and Sanitation Coordination Committee through the Ministry of Public Works and Utilities, Government of Kiribati. Australian National University.

White I. 2010b. Tarawa Water Master Plan: Te Karau, rainwater harvesting, storage and use. Coordinated by the National Adaptation Steering Committee under Office Te Beretitenti and the National Water and Sanitation Coordination Committee through the Ministry of Public Works and Utilities, Government of Kiribati. Australian National University.

White I. 2011a. Tarawa Water Master Plan: Other water sources. Coordinated by the National Adaptation Steering Committee under Office Te Beretitenti and the National Water and Sanitation Coordination Committee through the Ministry of Public Works and Utilities, Government of Kiribati. Australian National University.

White I. 2011b. Tarawa Water Master Plan: Te Ran-Maitira ae Kainanoaki, future water demand. Report to KAP Office, February 2011. Australian National University. 59 p

White I. and FalkLand T. 2009. Water Master Plan for Tarawa: Te Karau, rainwater harvesting, storage and use. Government of Kiribati, Tarawa.

White I, FalkLand A. and Rebgetz M. 2008. Report on the protection and management of water reserves, South Tarawa. KAPII Component 3, Freshwater Resources. Project 3.2.1. Australian National University.

World Bank (undated). Impact of climate change on low islands — Tarawa Atoll, Kiribati. Chapter 4 of the Pacific Islands Volume. Accessed online Oct 2014 at: <siteresources.worldbank.org/INTPACIFICISLANDS/.../4-Chapter+4.pdf>

WHO (World Health Organization). 2006. Guidelines for drinking-water quality. First Addendum to Third Edition, Volume 1. Recommendations, World Health Organization, Geneva. 585 p.

Annexes

Annex 1: Preliminary findings of the Bonriki Inundation Vulnerability Assessment groundwater models

The preliminary Bonriki Inundation Vulnerability Assessment (BIVA) groundwater models indicate:

- that current abstraction is causing an increasing trend in salinity;
- abstraction and the rainfall recharge are the most critical components influencing the lens and salinisation impacts;
- impact from abstraction is greater than sea-level rise impacts over the next 50 years;
- the area of salinity impact from inundation is restricted to the area that is inundated;
- recovery from inundation takes about two to six years, depending on rainfall; and
- recovery from abstraction impacts is longer than from inundation impacts.

Given these findings, the BIVA project economic analysis focuses on six representative scenarios and the expected number of days that salinity is above the 1,500 $\mu\text{S}/\text{cm}$ threshold in each.

Annex 2: Bonriki Inundation Vulnerability Assessment inundation modelling

Table A2 briefly describes the categories of inundation extents to the Bonriki water reserve that were identified under different wave height, water levels and sea-level rise probabilities and scenarios used in the BIVA project. For more detailed information please see Bosserelle et al. (2015) and Damlamian et al. (2015).

Table A2: Seawater inundation extents and impact on groundwater.

Inundation extents to Bonriki water reserve	Expected inundation impact on Bonriki groundwater?	Used in this analysis?	Greenhouse gas emission scenario and sea-level rise projection for 2064 reference
No inundation	No	Yes	No sea-level rise
Minimal inundation	No	No	No sea-level rise
Moderate inundation	Yes	No	Medium emission scenario (RP6) with sea-level rise projection for 2064 (PACCSAP 2014)
Severe inundation	Yes	No	High emission scenario (RP8.5) with sea-level rise projection for 2064 (PACCSAP 2014)
Extreme inundation	Yes	Yes	Intermediate-high emission scenario from the US National Oceanic and Atmospheric Administration (Parris 2012)